

Chemical, Physical and Biological Characterization of Devils Lake 1995 - 2005

Final December 2006

Prepared by:
Grant Neuharth
Environmental Scientist
North Dakota Department of Health
Division of Water Quality
918 E. Divide Ave., 4th Floor
Bismarck, ND 58501-1947



**North Dakota Department of Health
Division of Water Quality**

Acknowledgements

I would like to thank the many individuals and organizations who contributed to this report. Scott Elstad and James Meek, formerly with the North Dakota Department of Health, Division of Water Quality are responsible for the Devils Lake sampling program prior to 2006 and wrote the annual reports which are the foundation of the 2005 report. Mike Ell provided project guidance and oversight. Joe Gross performed database management and assistance. Numerous staff members and temporary employees with the North Dakota Department of Health, Division of Water Quality provided assistance with field sampling.

Table of Contents

Introduction	1
Methods	1
Results and Discussion	5
Literature Cited	18

Appendix A - Water Quality Results for Devils Lake 1995-2004**List of Figures**

Figure 1. Major Subwatersheds within the Devils Lake Basin	2
Figure 2. Locations of Devils Lake Sample Sites	3
Figure 3. Average Daily Elevation of Devils Lake at United States Geological Survey (USGS) Station 05056500 near Devils Lake, ND	4
Figure 4. Surface Concentrations (collected at 1 meter) of Selected Parameters and Secchi Disk Transparency for Each Devils Lake Sampling Site and Event in 2005	8
Figure 5. Annual Mean Concentration of Selected Parameters at Each Devils Lake Sampling Site for the Period of 1995 – 2005	11
Figure 6. Temperature and Dissolved Oxygen Profiles for Each Devils Lake Sampling Site and Event in 2005	14

1.0 Introduction

The Devils Lake Basin is comprised of 2.4 million acres in northeastern North Dakota (Figure 1). The watershed is located in the Northern Glaciated Plains ecoregion and is an undulating mix of integrated and nonintegrated drainage patterns. Streams within the basin are primarily intermittent. The two primary drainages are Channel A and Big Coulee (Mauvais Coulee). Channel A drains the Dry Lake, Edmore, Starkweather and Sweetwater areas, while Big Coulee drains Lake Irving, Lake Alice, Chain of Lakes and Mauvais Coulee (Figure 2).

Devils Lake is a hypereutrophic saline lake comprising approximately 140,000 acres. It is located in southern Ramsey and northern Benson counties. The Devils Lake chain consists of several bays and East Devils Lake. Based on the dominant cations and anions in solution, water in Devils Lake is of the sodium-sulfate type.

Water levels for Devils Lake were first recorded in 1860. Since then there have been extreme fluctuations in the water level (Figure 3). Along with these water level changes there have been corresponding changes in total dissolved solids (TDS) concentrations. These changes have affected aquatic community structure. Fluctuating water levels are primarily related to the closed basin nature of the system. The absence of a surface outlet and the fact that annual evaporation frequently exceeds annual precipitation are important causes of the high TDS. Spring runoff, most of which enters the system through West Bay (naturally) and Six Mile Bay (Channel A), is the major source of water. According to the United States Geological Survey (USGS), about 80 percent of the water contributed to Devils Lake enters through these two sources (Greg Wiche pers. comm.). Groundwater also contributes to the hydrologic budget. As a result, Devils Lake is extremely vulnerable to widely fluctuating lake levels.

Nutrients and TDS are identified as the important variables affecting water quality in Devils Lake. High concentrations of nutrients in Devils Lake cause prolific algal blooms dominated by cyanophyta (blue-green algae). These algal blooms result in impaired water-based recreation. TDS affects fish reproduction, fish growth and algal blooms.

2.0 Methods

Currently, seven sites are sampled each year across the Devils Lake chain of lakes. The seven sites and their location are 380236 (West Bay); 384160 (S.W. West Bay); 380221 (Six Mile Bay); 380233 (Main Bay); 380234 (East Bay); 380235 (East Devils Lake); and 385029 (Pelican Lake) (Figure 2). Sampling was initiated at the Pelican Lake site in 1999 and the S.W. West Bay site in 1997, while the remaining sites were initiated in 1995. The sites are typically sampled four times annually, once in February (under ice cover), May, August, and October. At various times in the past, there were more sites sampled or more frequent sampling but, this report will focus only on those sites currently in the Devils Lake sampling program.

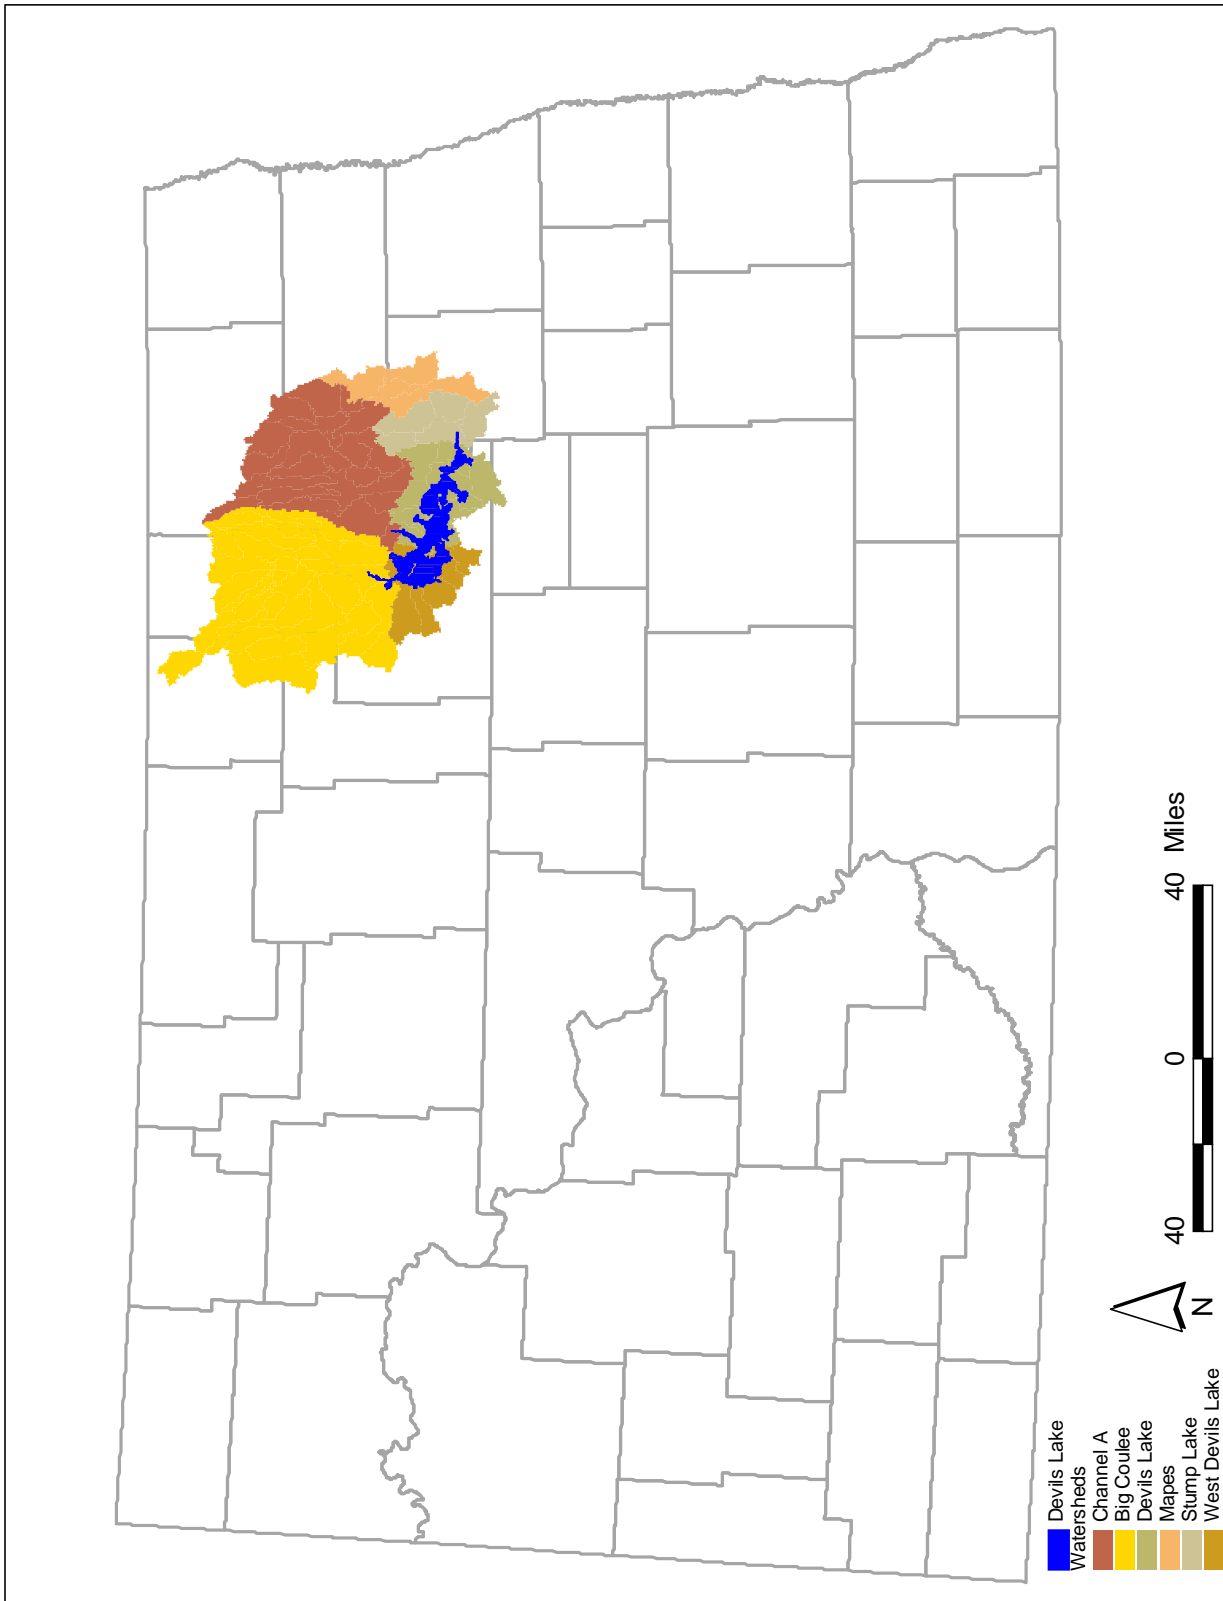


Figure 1. Major Subwatersheds within the Devils lake Basin

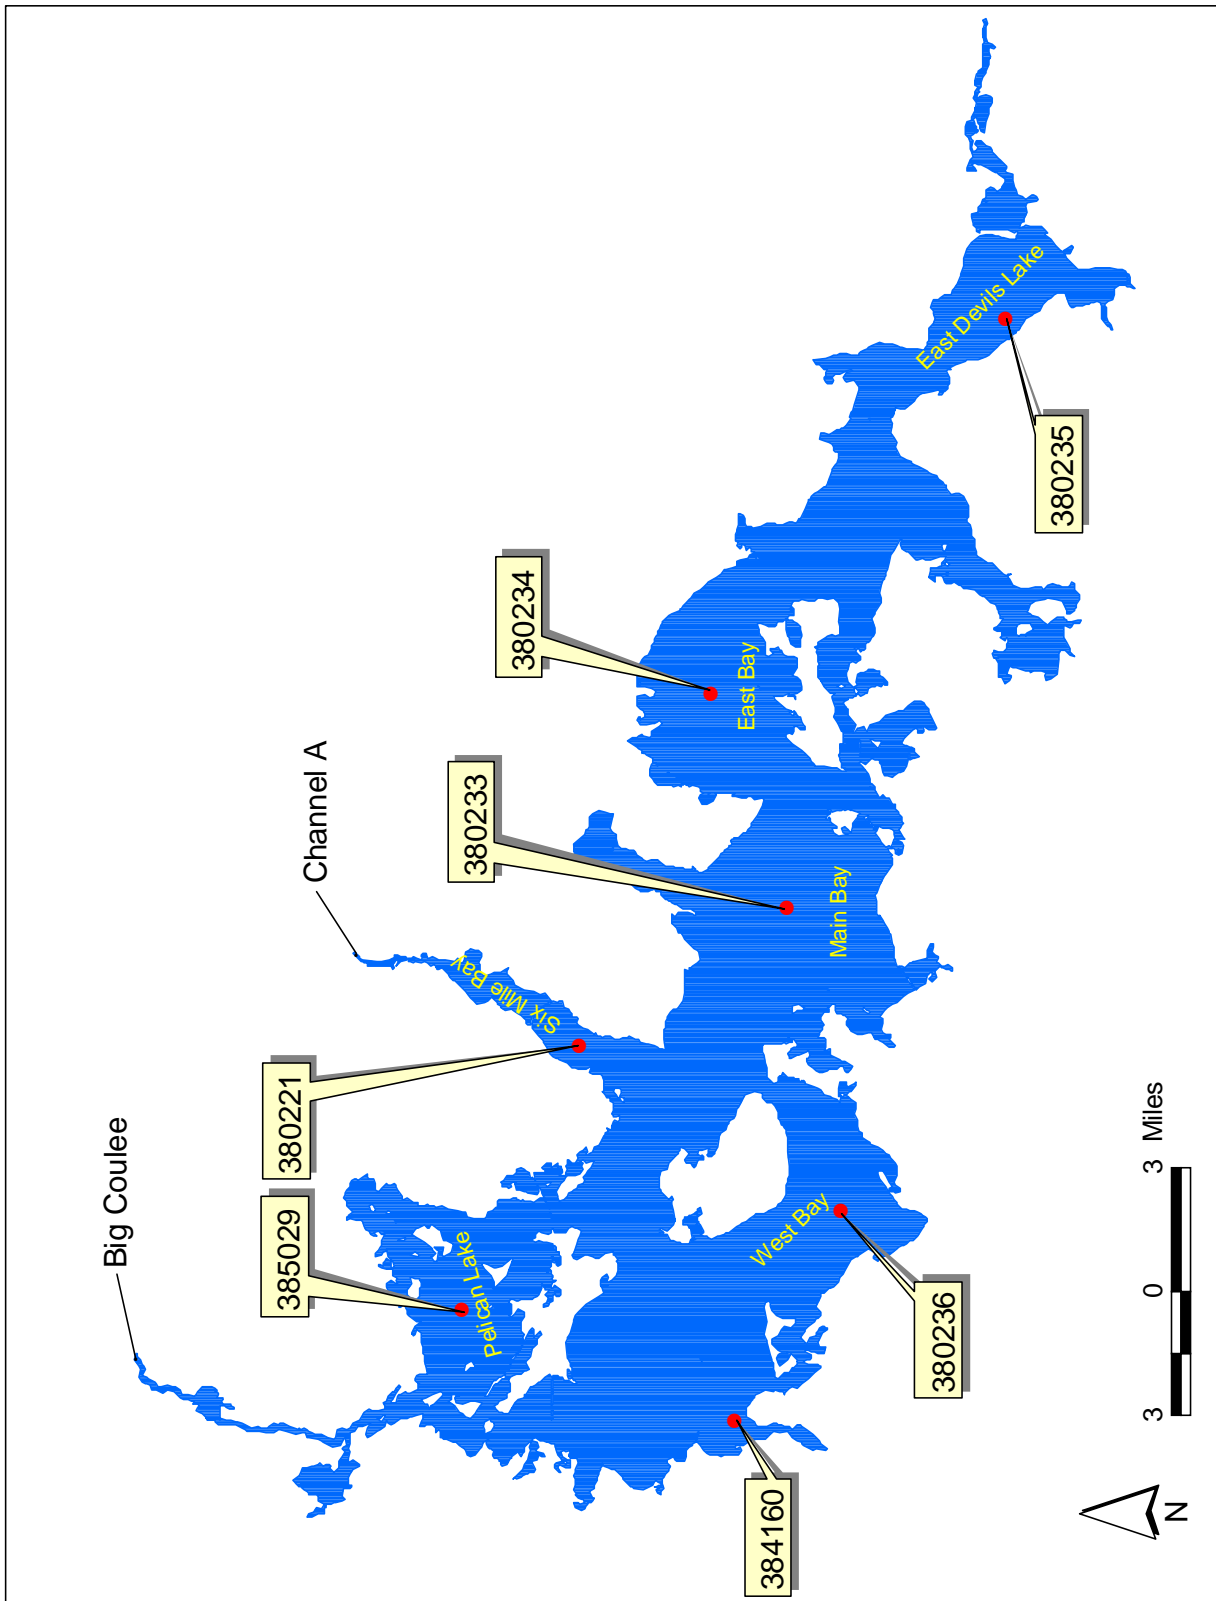


Figure 2. Locations of Sample Sites in Devils Lake

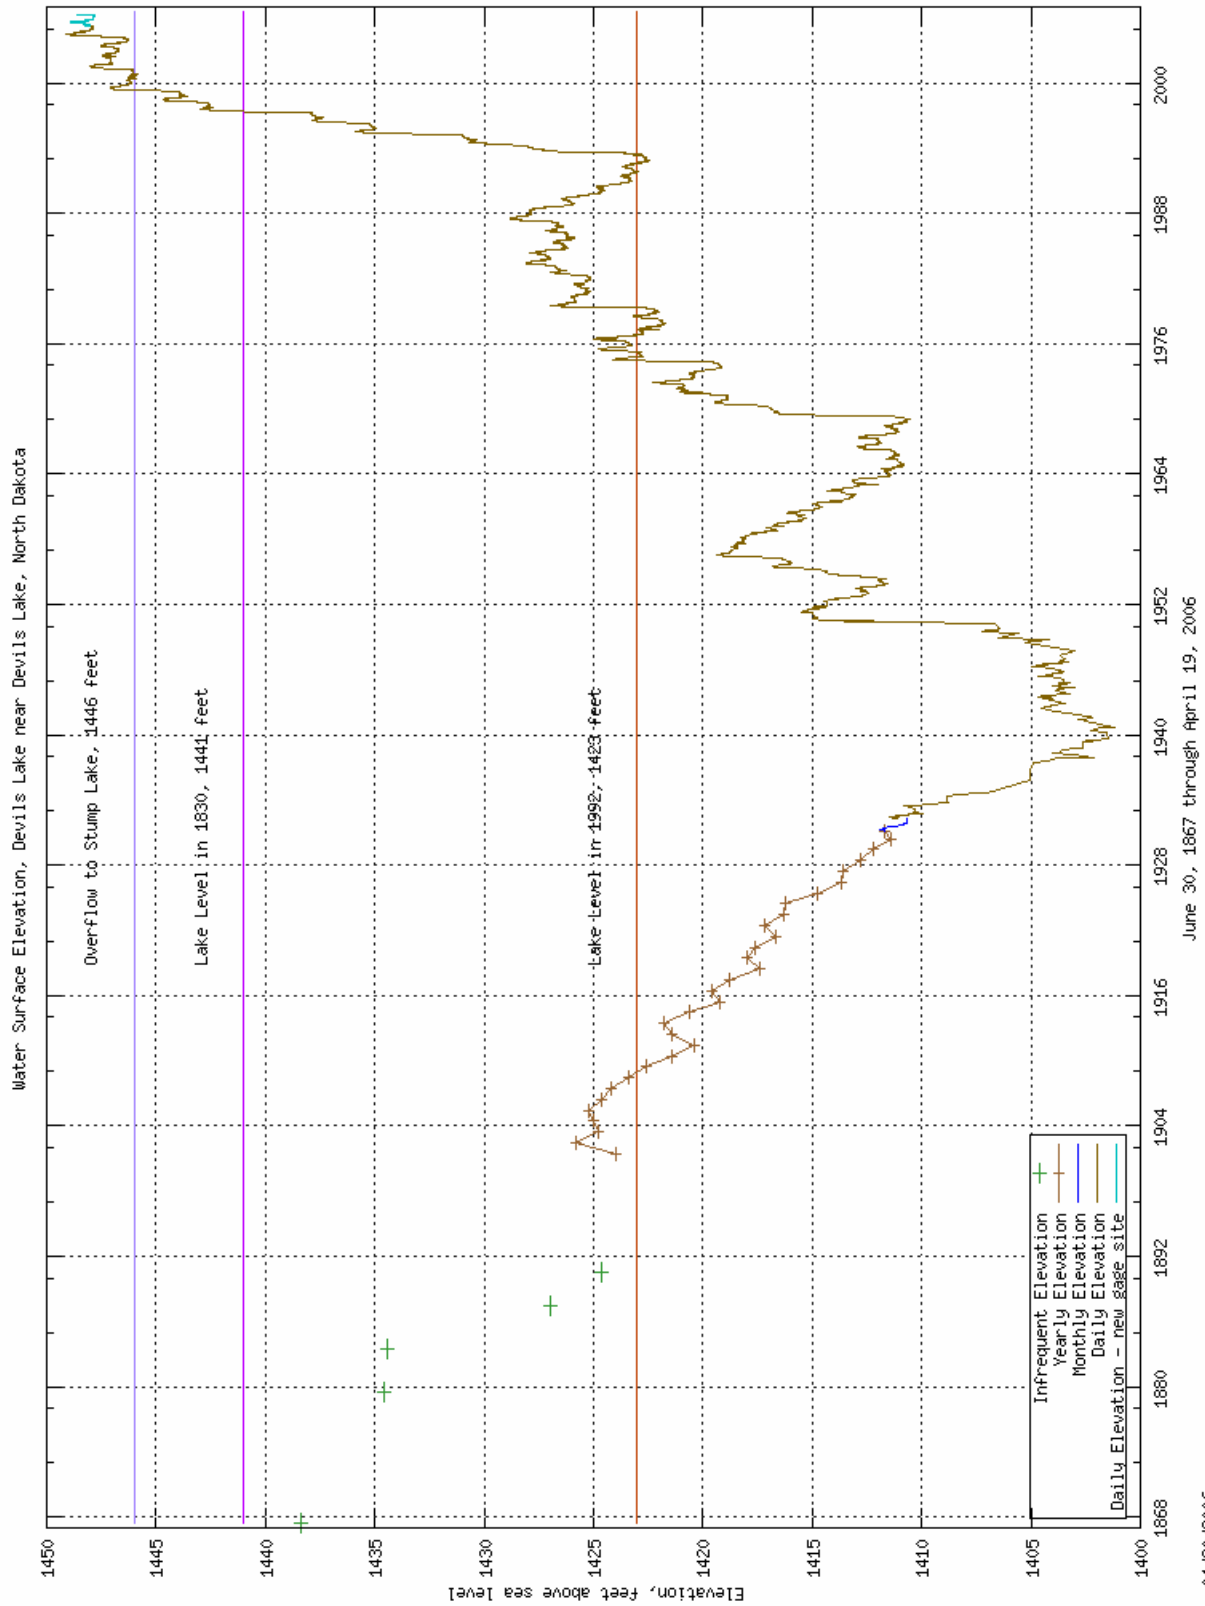


Figure 3. Average Daily Elevation of Devils Lake at United States Geological Survey (USGS) Station 05056500 near Devils Lake, ND.

04/20/2006

Physical, chemical and biological variables are sampled at each site and consists of the following: dissolved oxygen, pH, temperature and conductivity profiles; chlorophyll-*a*; phytoplankton; ammonia as N; total Kjeldahl nitrogen; nitrate-nitrite as N; total phosphate as P; dissolved phosphate as P; total dissolved solids; major cations/anions; and trace elements. Temperature, oxygen, pH and specific conductivity profiles were recorded at one-meter intervals. Chlorophyll-*a* and phytoplankton are collected as a composite sample of the top two meters of the water column. The remaining chemical variables are analyzed from two discrete samples collected at about one meter below the surface and one meter above the bottom. A mid-column sample is collected at the center of the water column or just below the thermocline, if present, for sites greater than four meters in depth. Secchi disk transparency is also measured at each site.

Water quality samples are collected, handled and tracked in accordance with procedures outlined in the North Dakota Department of Health, Division of Water Quality's Standard Operating Procedures for Field Samplers (NDDoH, 2001). Quality assurance/quality control protocols are outlined in the Standard Operating Procedures for Field Samplers. Analytical methods and procedures used for analysis of water quality samples are described in the North Dakota Department of Health, Division of Chemistry's Quality Assurance Plan (NDDoH, 2000). All results are available in the EPA's STORage and RETrieval database (STORET).

3.0 Results and Discussion

Considering the volume and relevancy of data collected in Devils Lake over the last ten years, this report focuses on surface (1 meter) concentrations or measurements of conductivity, chloride (Cl⁻), sulfate (SO₄⁻), total dissolved solids (TDS), total ammonia (NH₃-NH₄), nitrate-nitrite (NO₃⁻-NO₂²⁻), total nitrogen (TN), dissolved phosphorus (DP), total phosphorus (TP), chlorophyll-*a*, and Secchi depth. This report discusses both intra-year (within 2005, between seasons) and inter-year (between years, 1995-2005) spatial and temporal trends. Annual mean concentrations were used for the inter-year comparison. The existence of trends was determined through visual investigation of the figures provided in this report. Further statistical testing, which is outside the scope of this report, would be needed to determine the statistical significance of these trends and to possibly detect trends not visible in the figures. In addition, the seasonal temperature and dissolved oxygen profiles for 2005 will be discussed in terms of thermal stratification and dissolved oxygen depletion.

Conductivity, Chloride, Sulfate and TDS

In 2005 and throughout the entire sampling period (1995-2005), there has been a consistent spatial trend in conductivity, chloride, sulfate, and TDS concentrations. These parameters are closely related and any one of them could be used as a surrogate of the others. In general, the concentrations of these four parameters increase as you move from west to east in the Devils Lake chain. East Devils Lake has the highest concentrations by a considerable margin followed by East Bay. The concentrations in Main Bay, West Bay, SW West Bay, and Six Mile Bay are typically consistent with each other and Pelican Lake has the lowest concentrations (Figures 4a-d).

No significant intra-year temporal trends in conductivity, chloride, sulfate, or TDS concentrations

were observed in 2005 (Figures 4a-d). However, there are some inter-year temporal trends in these four parameters (Figures 5a-d). With heavy snow falls and subsequent surface runoff, Devils Lake water surface elevations began a rising trend in the spring of 1994. The filling of the lake continued until the summer of 1999 when Devils Lake began to flow eastward, through network of coulees, into neighboring Stump Lake. Since 1999 the water levels have continued to rise in Stump Lake and have not yet reached equilibrium with Devils Lake (USGS). In East Bay and East Devils Lake, the annual mean concentrations of these four parameters have decreased considerably since 1995. Contributing factors to this decrease in ions levels are eastward surface water flow into Stump Lake and dilution from increased surface runoff. The annual mean concentrations in Six Mile Bay and Main Bay have remained fairly consistent since 1995 while increasing slightly in Pelican Lake, SW West Bay, and West Bay (Figures 5a-d). There are conductivity values for Six Mile Bay, Main Bay, East Bay, East Devils Lake, and West Bay from 1990 and 1991 (Figures 5a). Considering the high conductivity and its relationship to chloride, sulfate, and TDS, it is reasonable to assume that all five bays also saw considerable decreases in concentrations from 1990 to 1995 (Figure 5a).

Nutrients, Chlorophyll-a and Secchi Depth

Both intra-year and inter-year spatial trends in nutrients and chlorophyll-a concentrations and Secchi depth are difficult to observe primarily because of the temporal variability inherent in those parameters. The exception involves East Devils Lake whose nitrate-nitrites, and total nitrogen concentrations tended to be higher than the other sampling locations both within 2005 (Figures 4f-g) and between 1995 and 2005 (Figures 5f-g).

In 2005, intra-year temporal trends are observable in chlorophyll-a, nitrate-nitrite and, Secchi disk transparency. In 2005, nitrate-nitrite concentrations at the majority of the sampling locations decrease from the winter (March) to the spring (May) and then remain relatively constant in the summer (August) and fall (October) samples (Figure 4e-f). Chlorophyll-a concentrations increase and the Secchi depth decreases from spring to fall at the majority of the sampling locations (Figure 4j-k). Inter-year temporal trends are observable for total nitrogen, total phosphorus, and dissolved phosphorus at some, but not all sites. The trends that are observable in the mean annual concentrations of total nitrogen are not consistent across all sampling locations. Total nitrogen concentrations in East Bay and Main Bay decreased considerably in 1998 and then remained relatively consistent through 2005. Mean annual total nitrogen concentrations in East Devils Lake trended differently, increasing considerably in 1998, remaining relatively constant through 2003, and then declining in 2004 (Figure 5g). Mean annual phosphorus and dissolved phosphorus concentrations appear to increase beginning in 1996, then display a peak in concentration around 1998, 1999, or 2000, and eventually decrease over the next five to seven years (Figure 5h-i).

Temperature and DO Profiles

In 2005, moderate thermal stratifications sufficient enough to at least limit mixing were observed during the winter visit at Six Mile Bay, Main Bay, East Bay, West Bay and, East Devils Lake. Only Six Mile Bay had a small section in the winter temperature profile where the thermal gradient is greater than one degree Celsius per meter. Dissolved oxygen depletions commonly

associated with thermal stratification were also observed during the winter at the above mentioned locations. The dissolved oxygen levels dropped near 2 mg/L in the deeper portions of the profiles at the previously mentioned sites with East Devils Lake as an exception (Figure 6a-g). None of the sampling locations demonstrated any significant thermal stratification or dissolved oxygen depletion during the spring, summer, or fall visits (Figure 6a-g). Pelican Lake's winter dissolved oxygen measurement shows a significant increase towards the surface. This elevated dissolved oxygen reading is attributed to mixing by the ice auger used to drill the sample hole and is not believed to reflect real conditions.

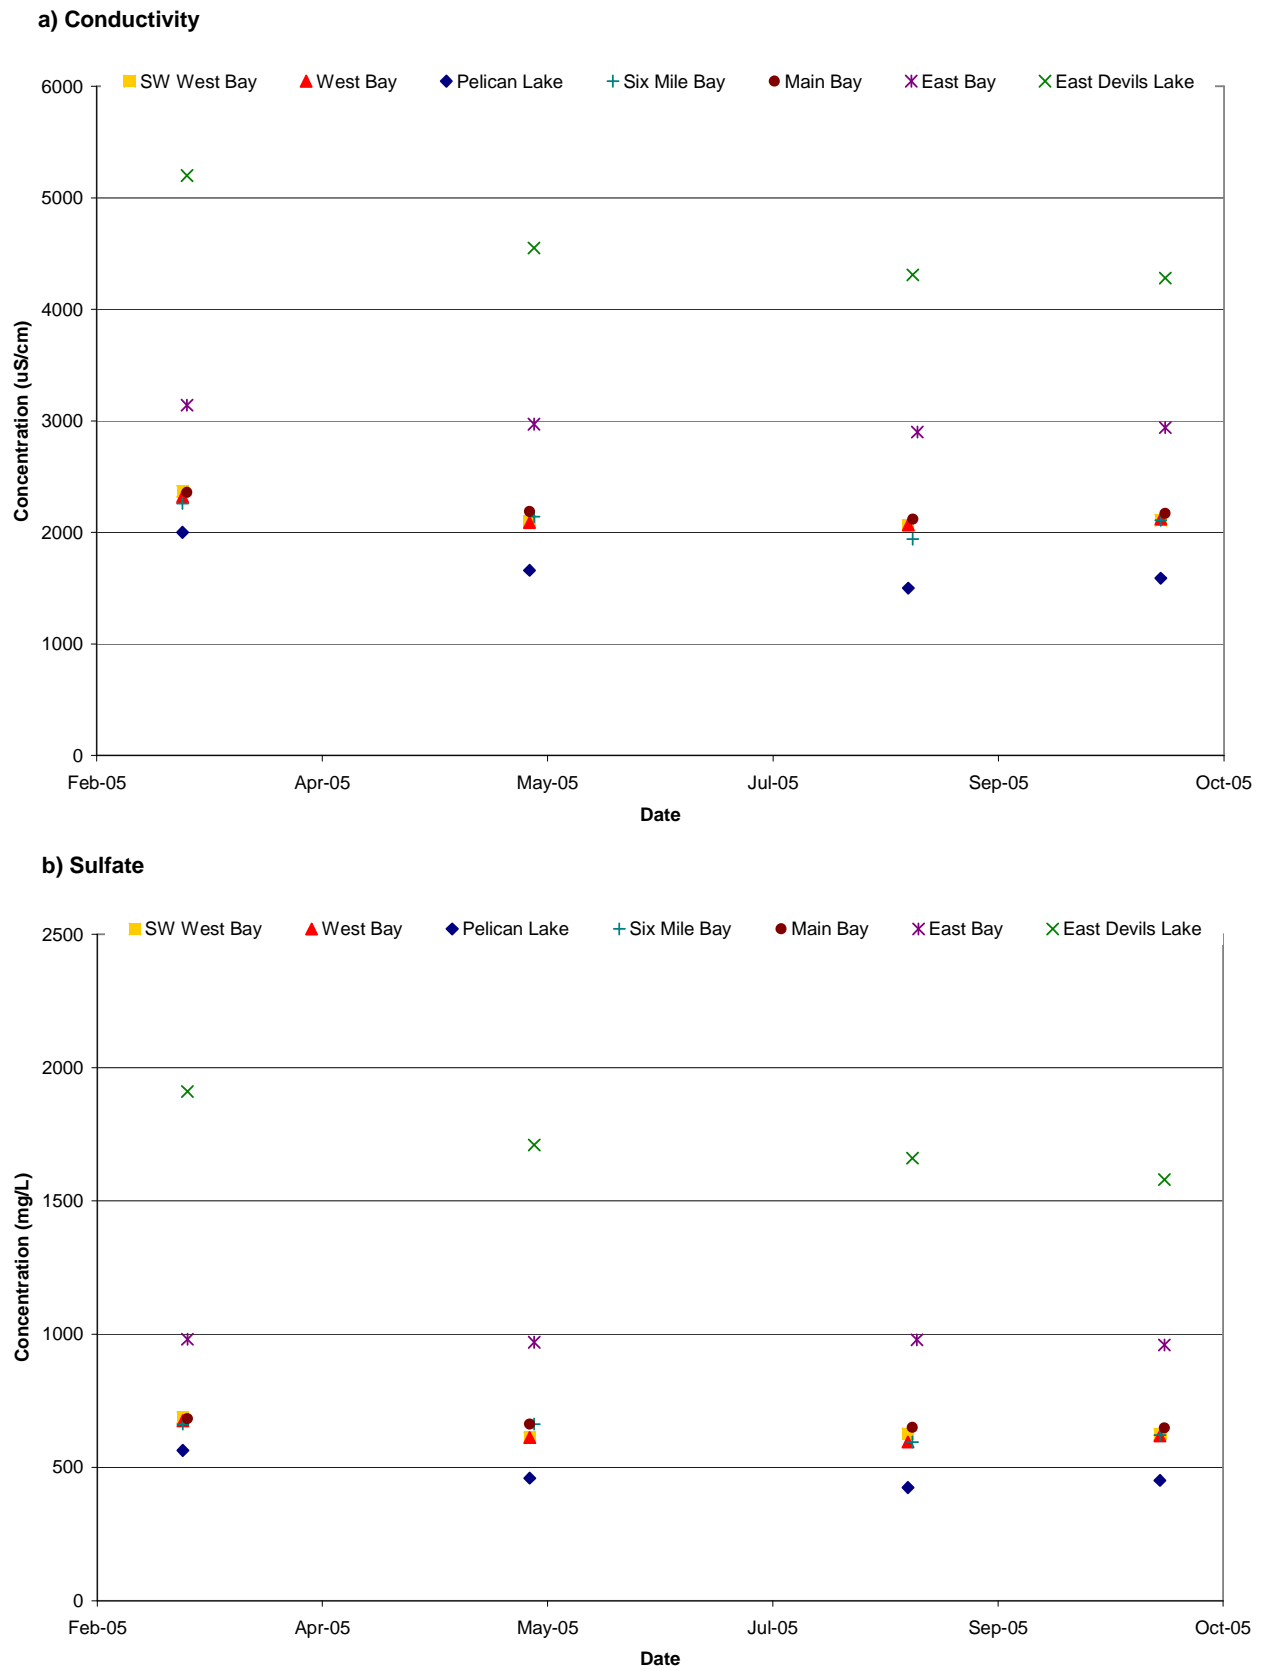


Figure 4. Surface Concentrations (collected at 1 meter) of Selected Parameters and Secchi Disk Transparency for Each Devils Lake Sampling Site and Event in 2005.

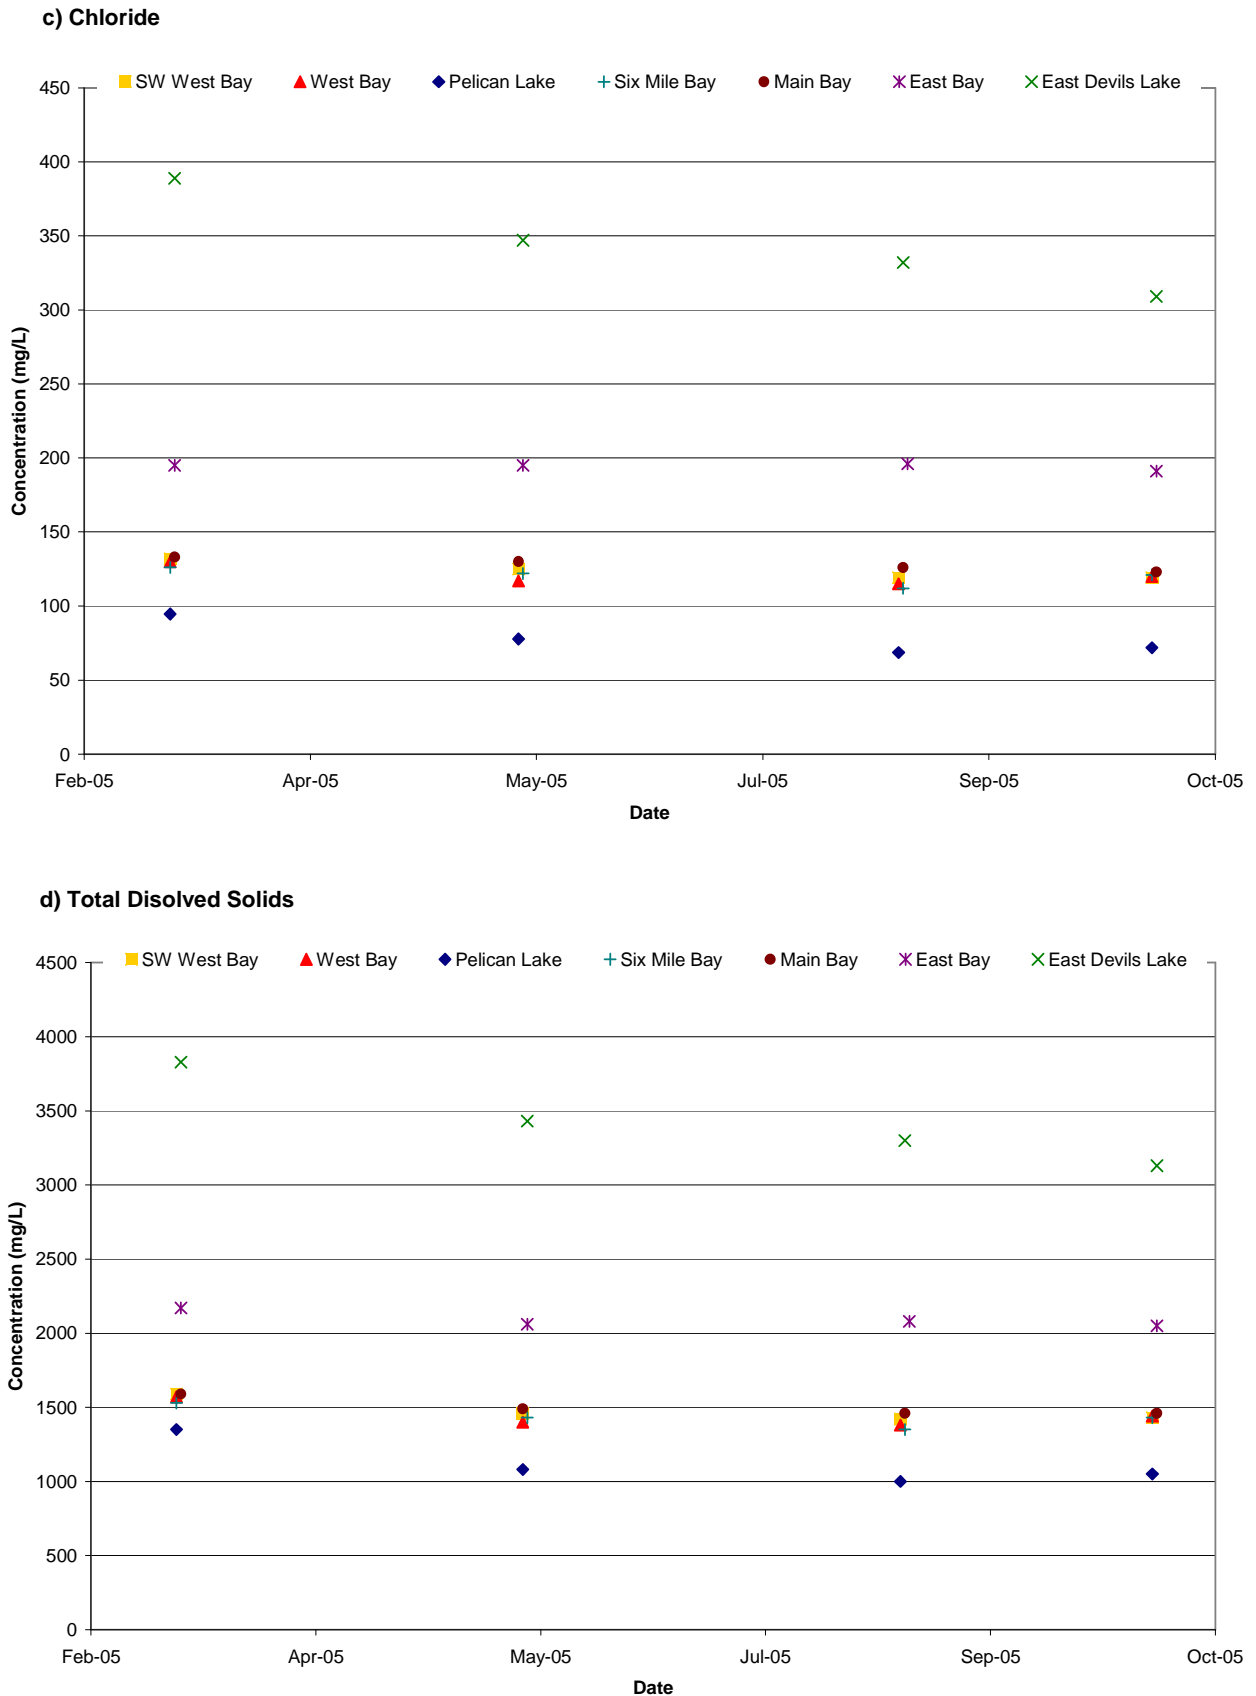


Figure 4. Continued

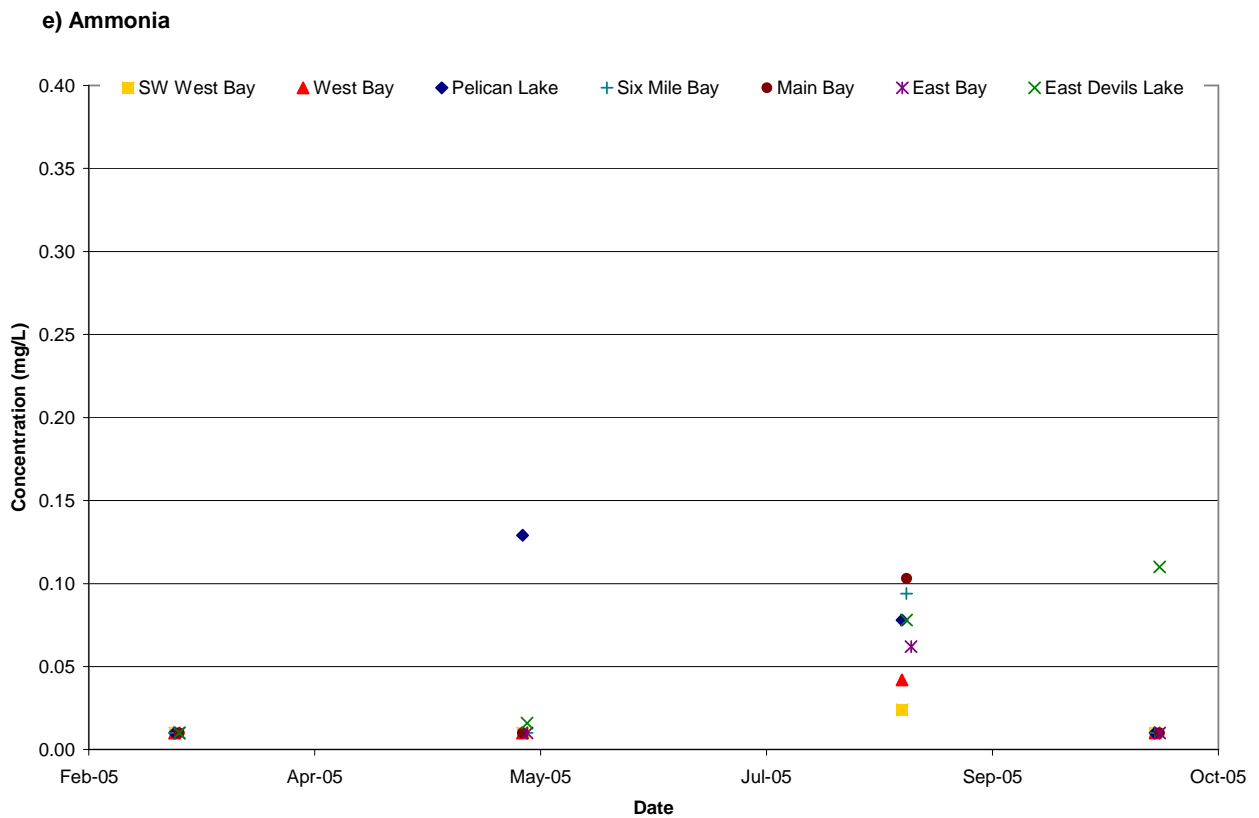
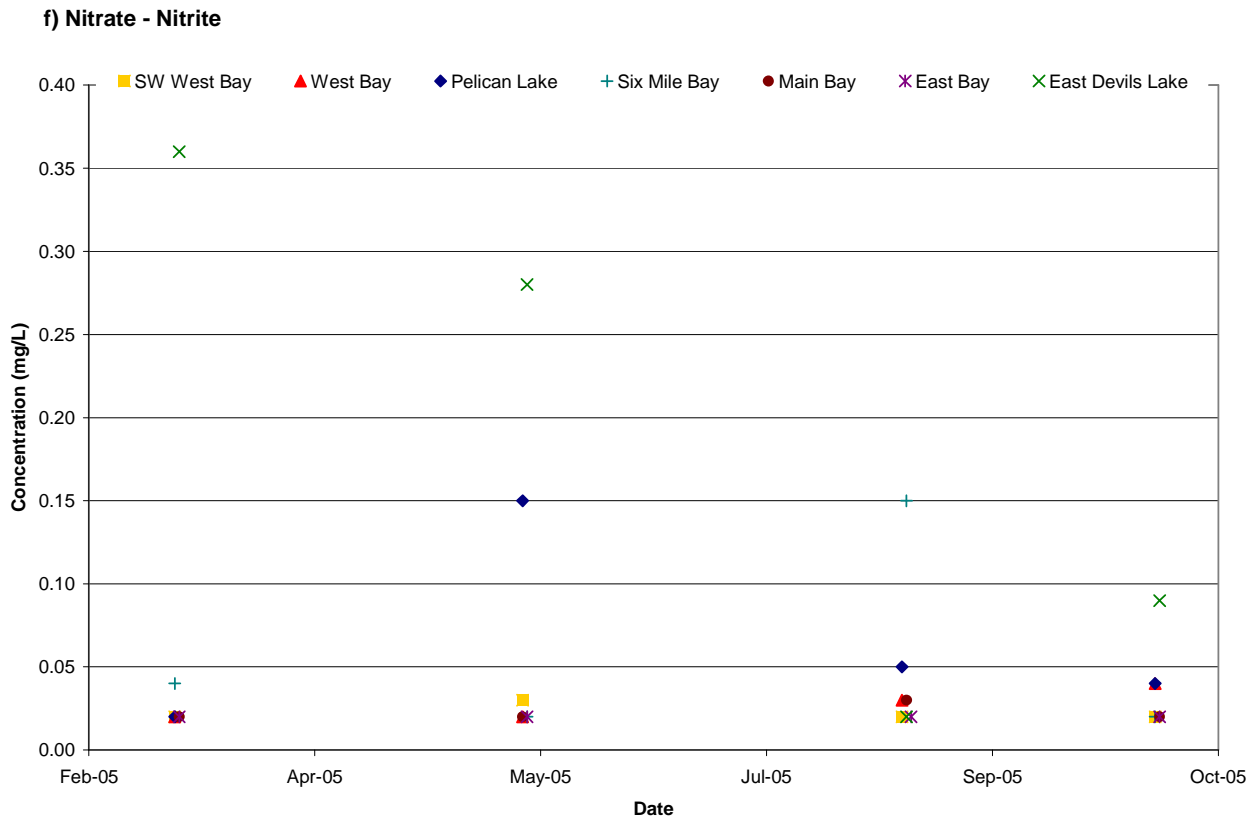


Figure 4. Continued



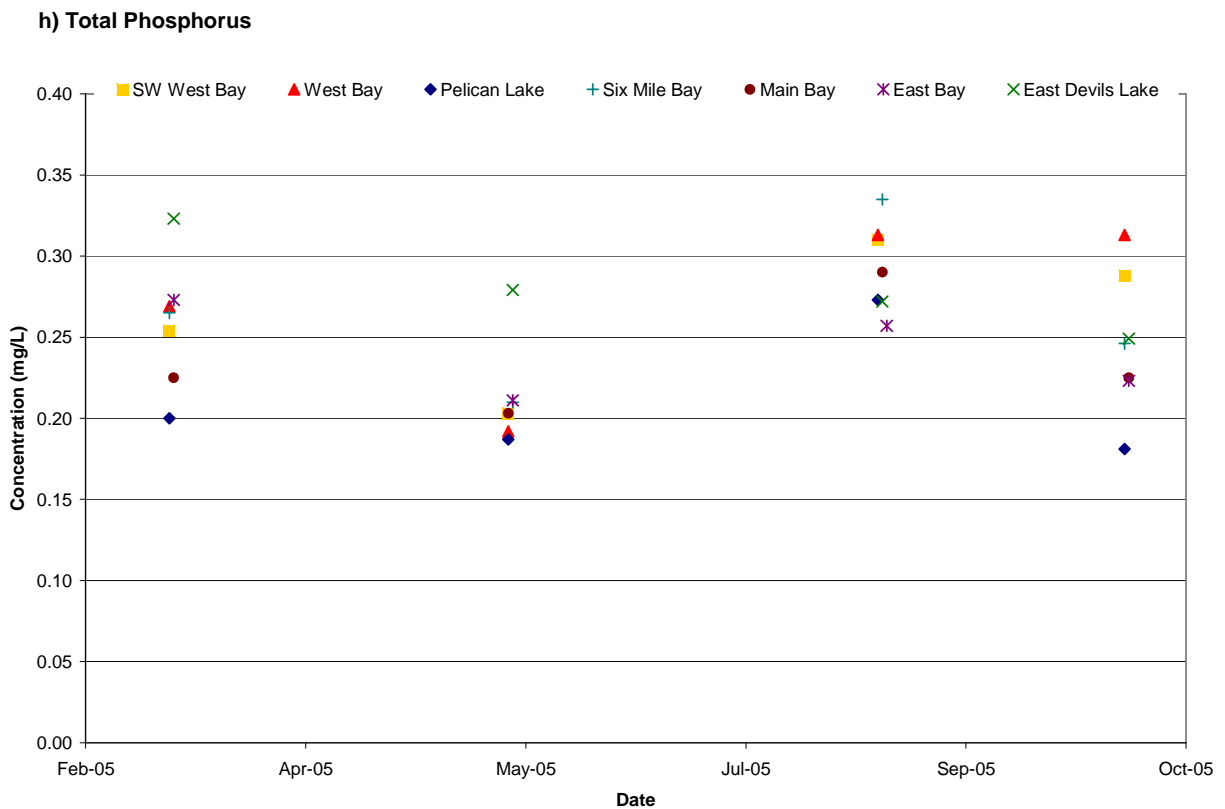


Figure 4. Continued

i) Dissolved Phosphorus

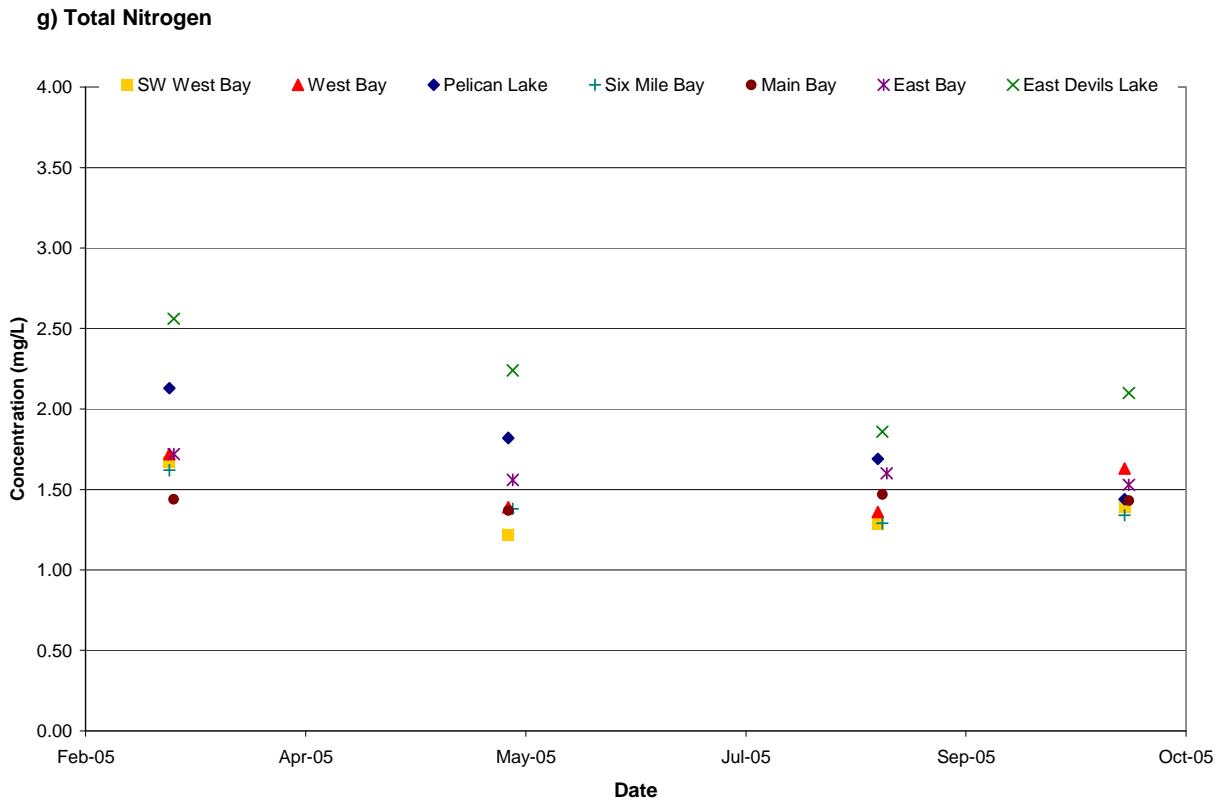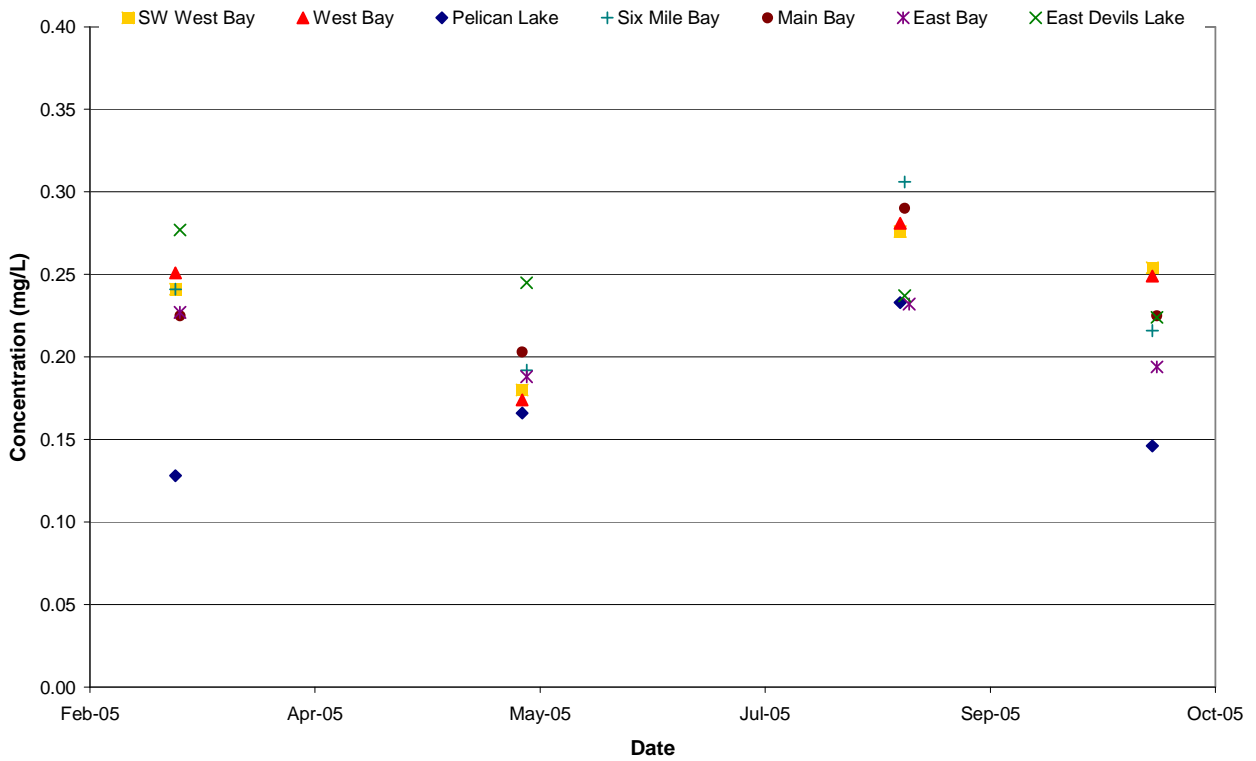

j) Chlorophyll - a

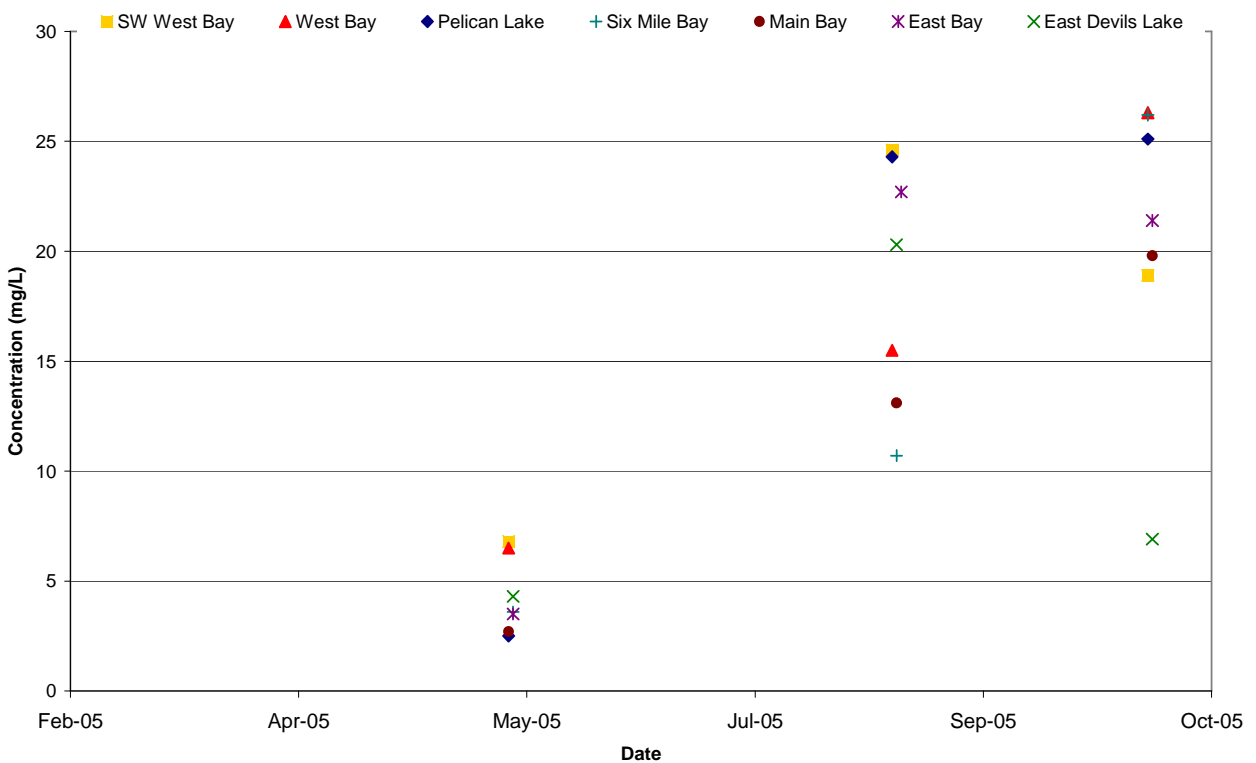


Figure 4. Continued

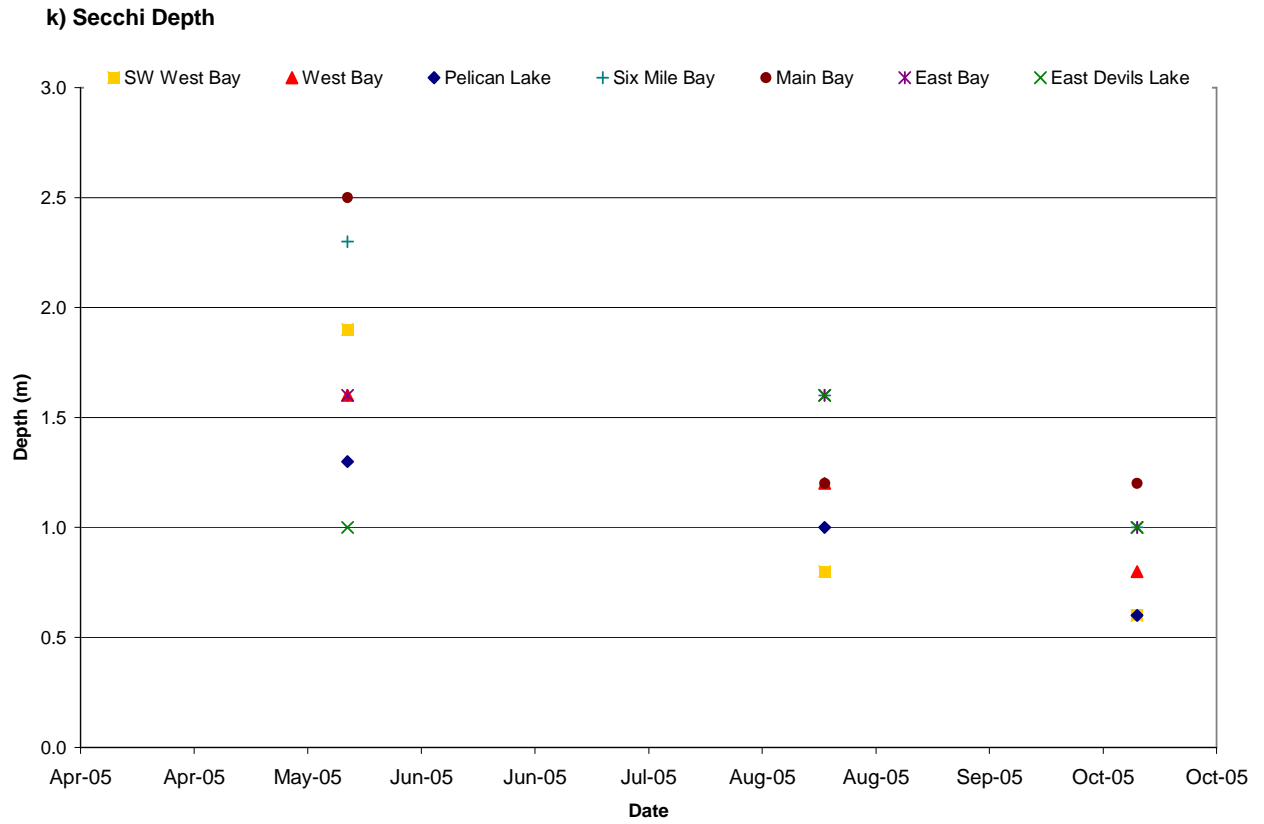


Figure 4. Continued

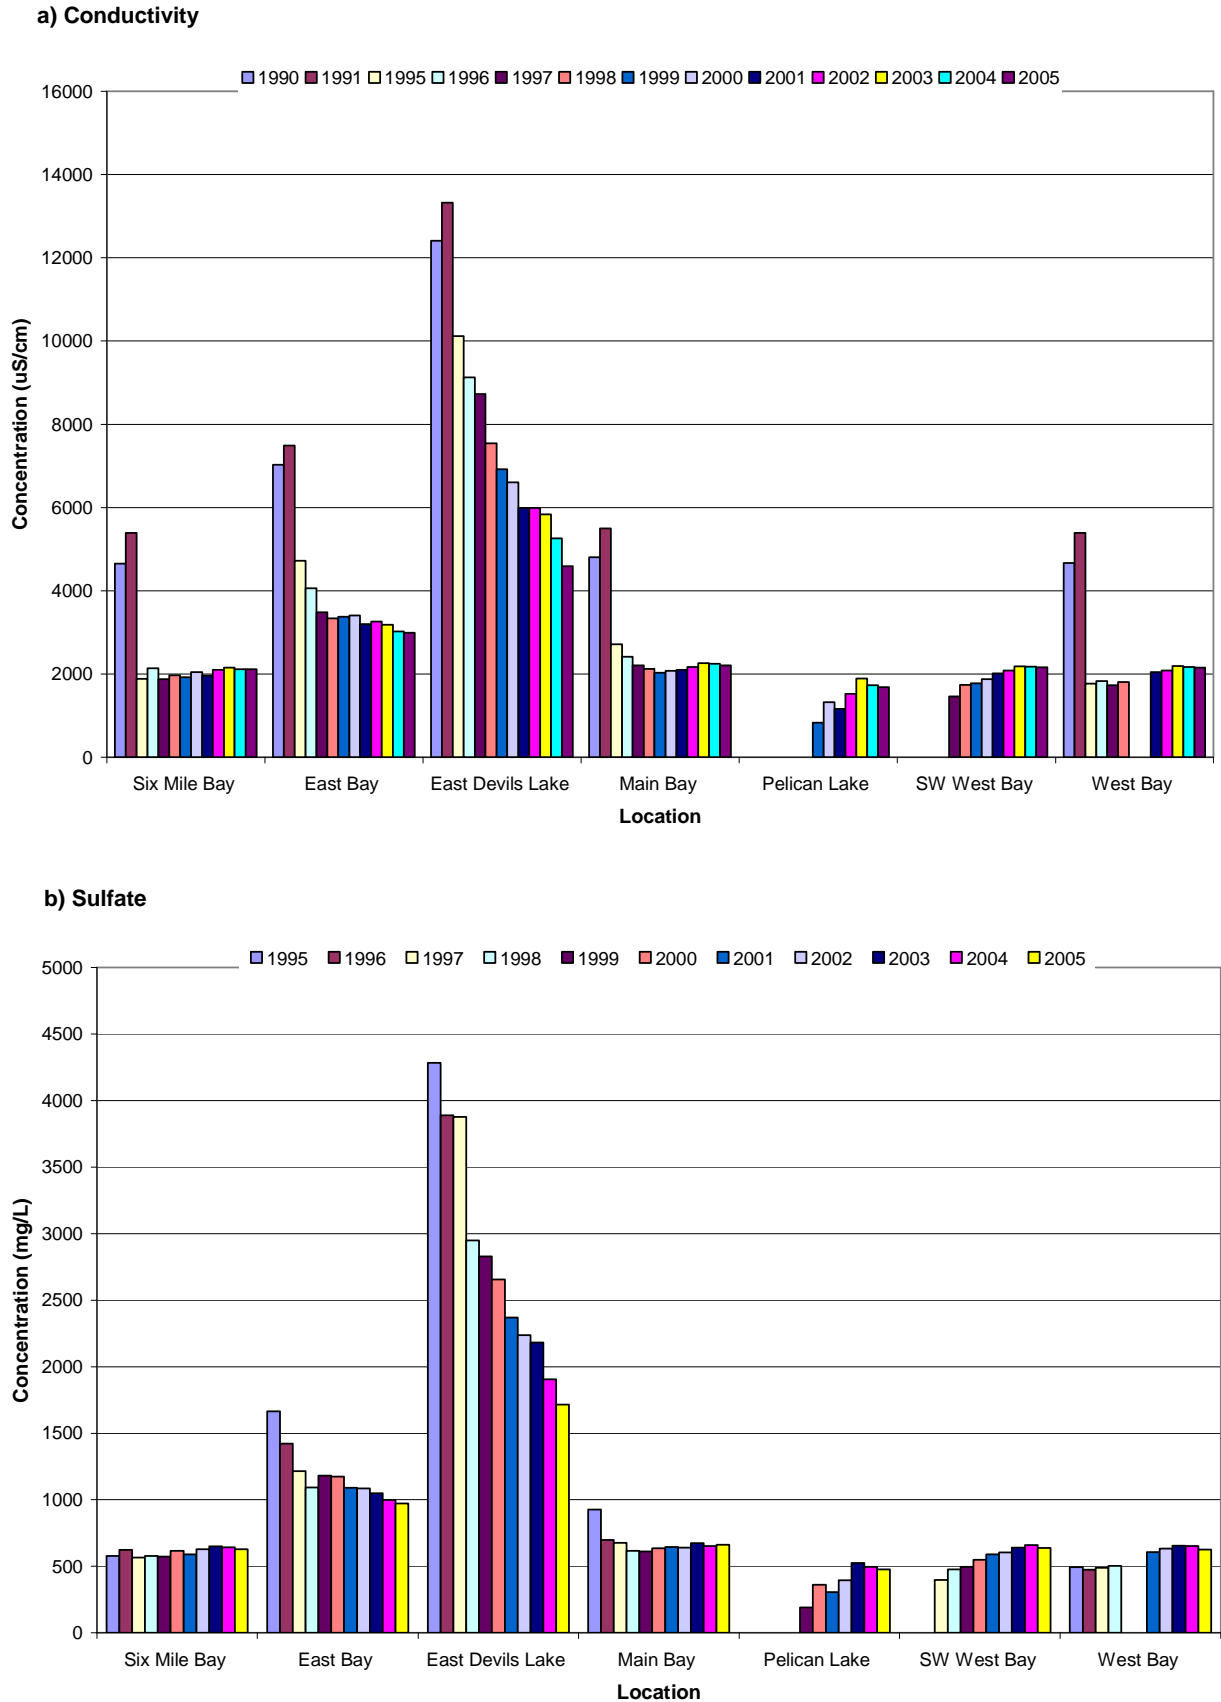


Figure 5. Annual Mean Concentration of Selected Parameters at Current Devils Lake Sampling Sites

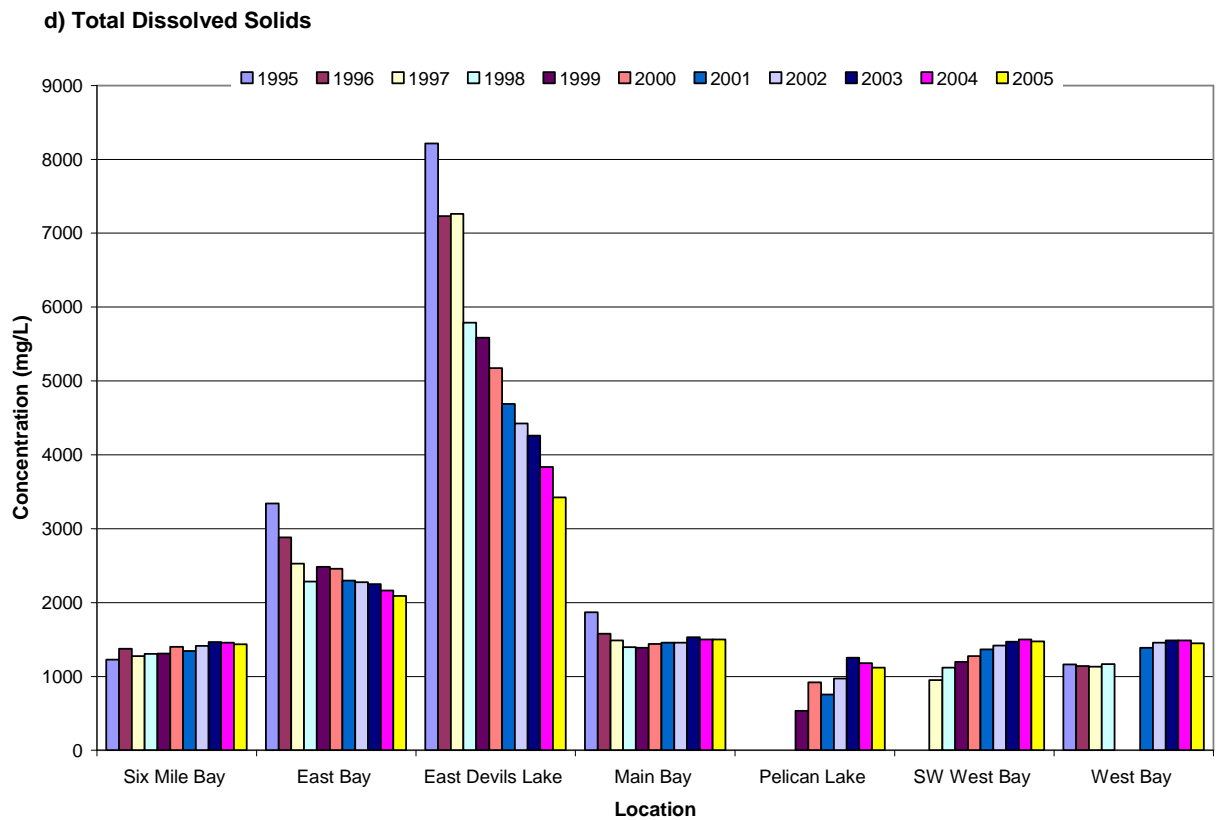
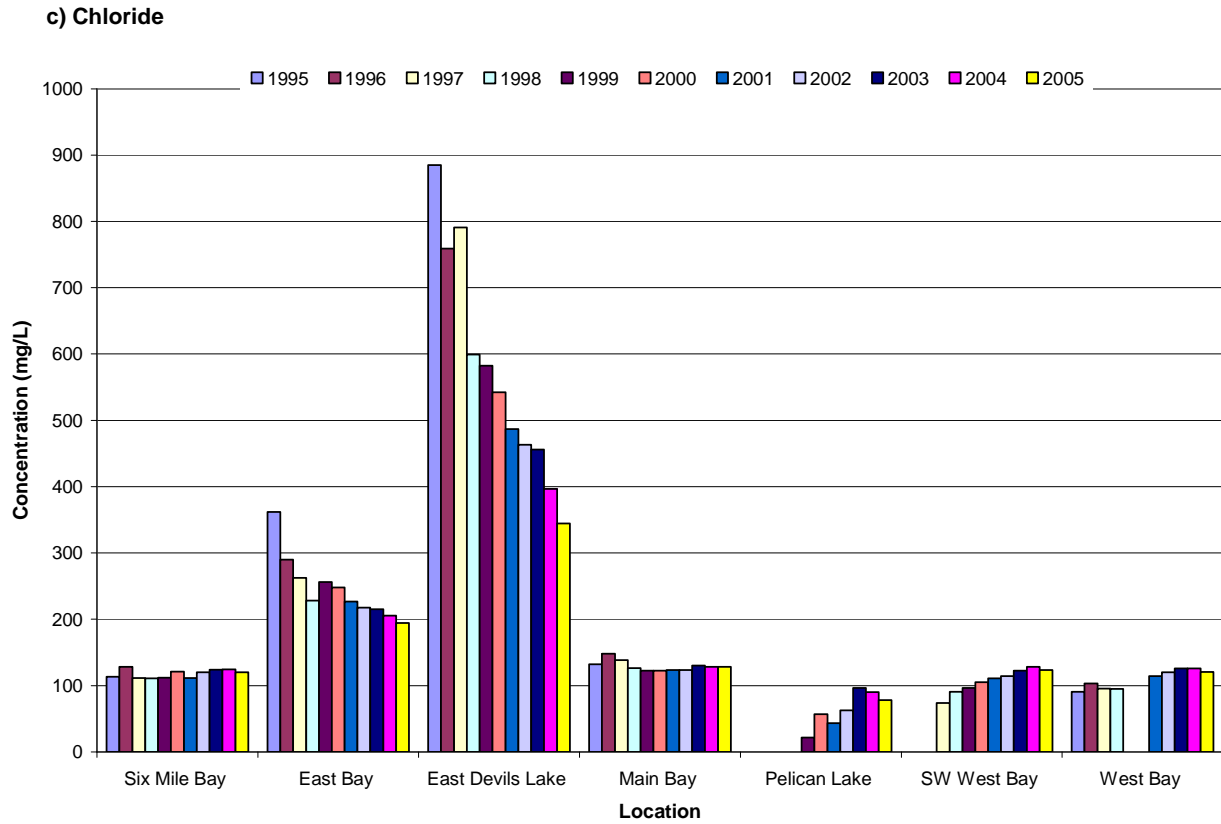


Figure 5. Continued

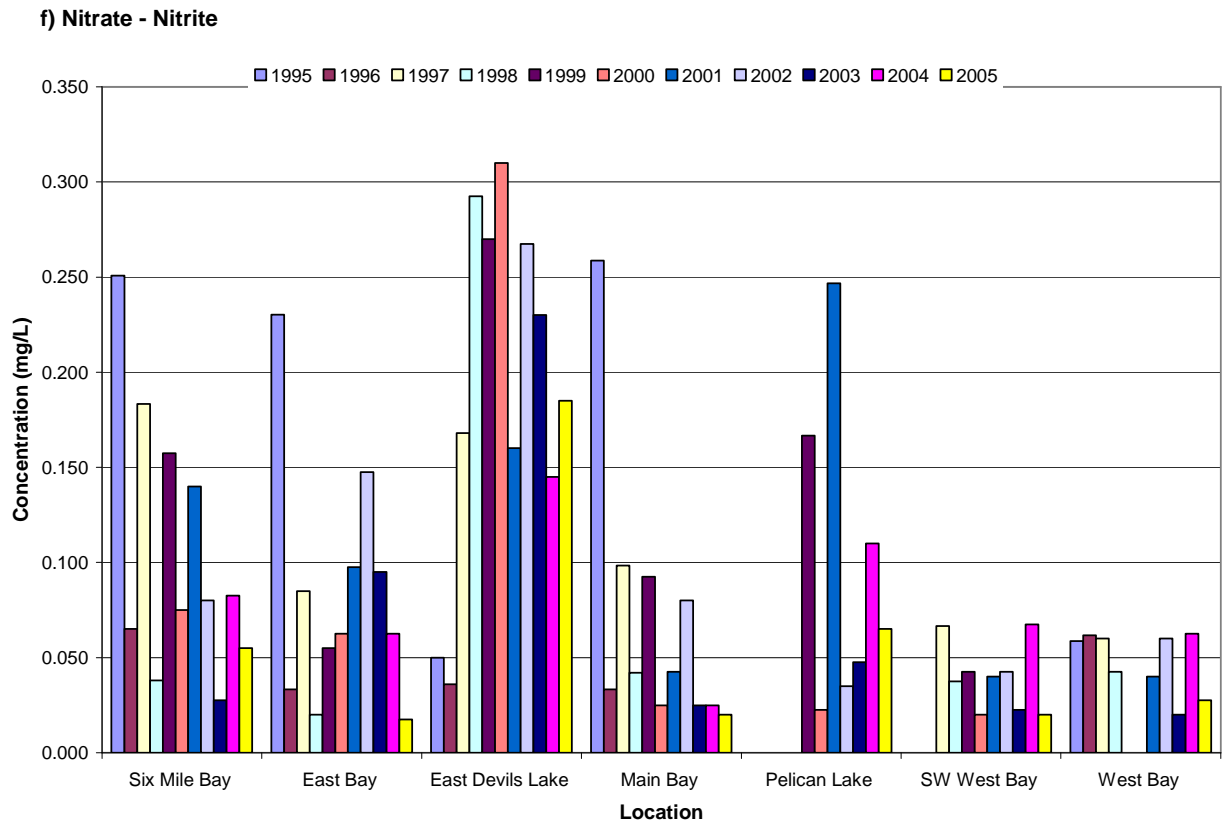
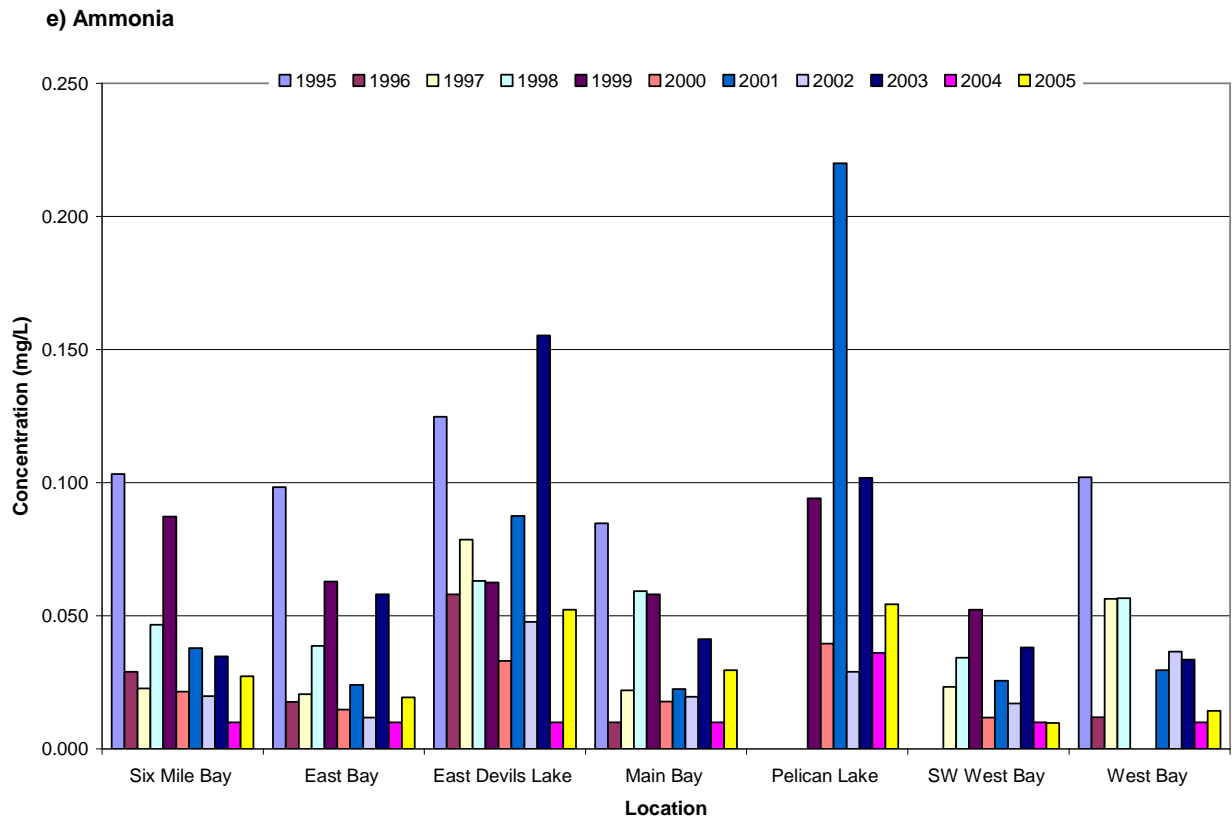


Figure 5. Continued



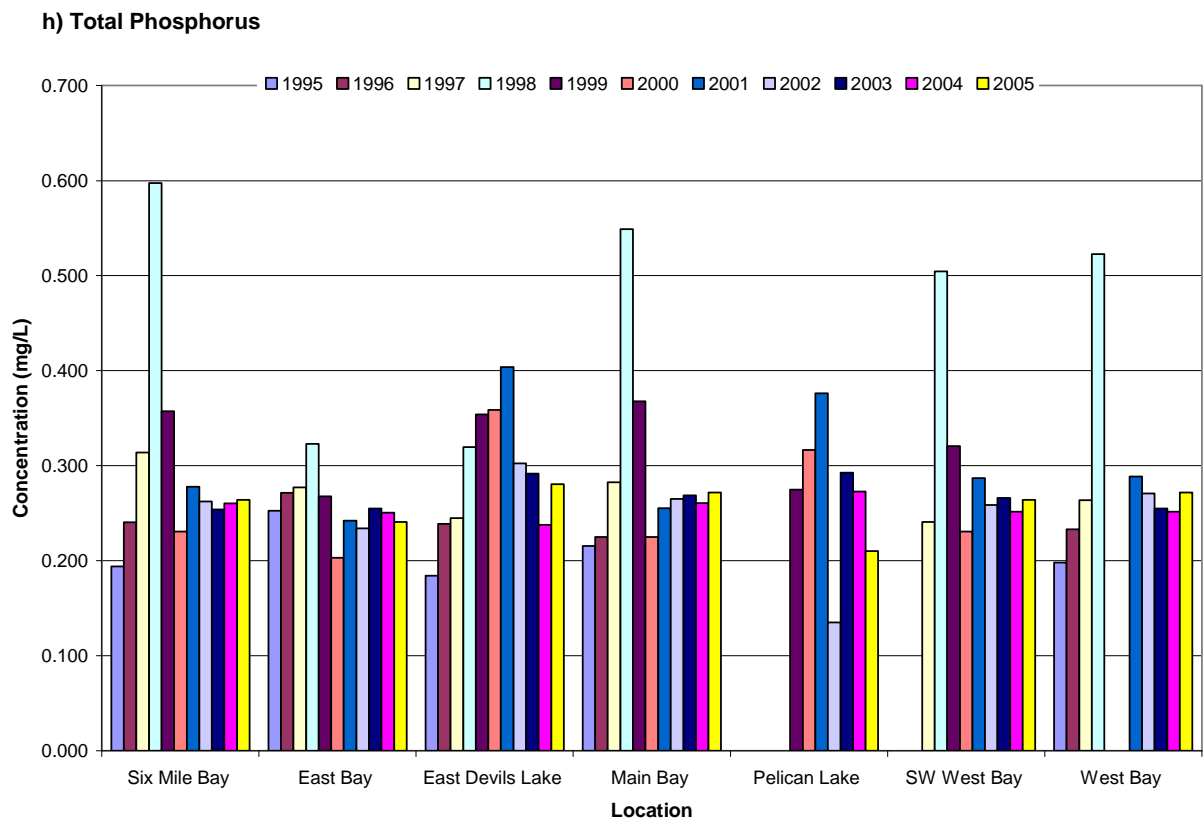


Figure 5. Continued

i) Dissolved Phosphorus

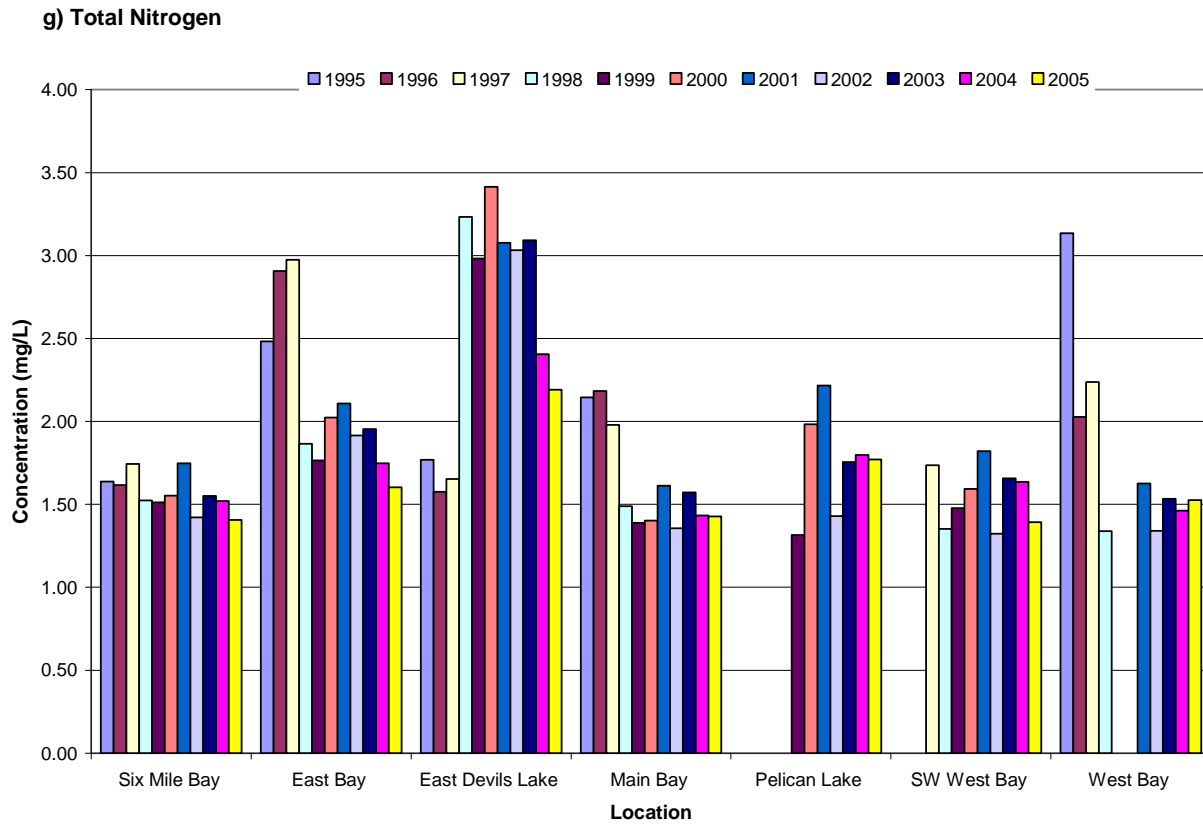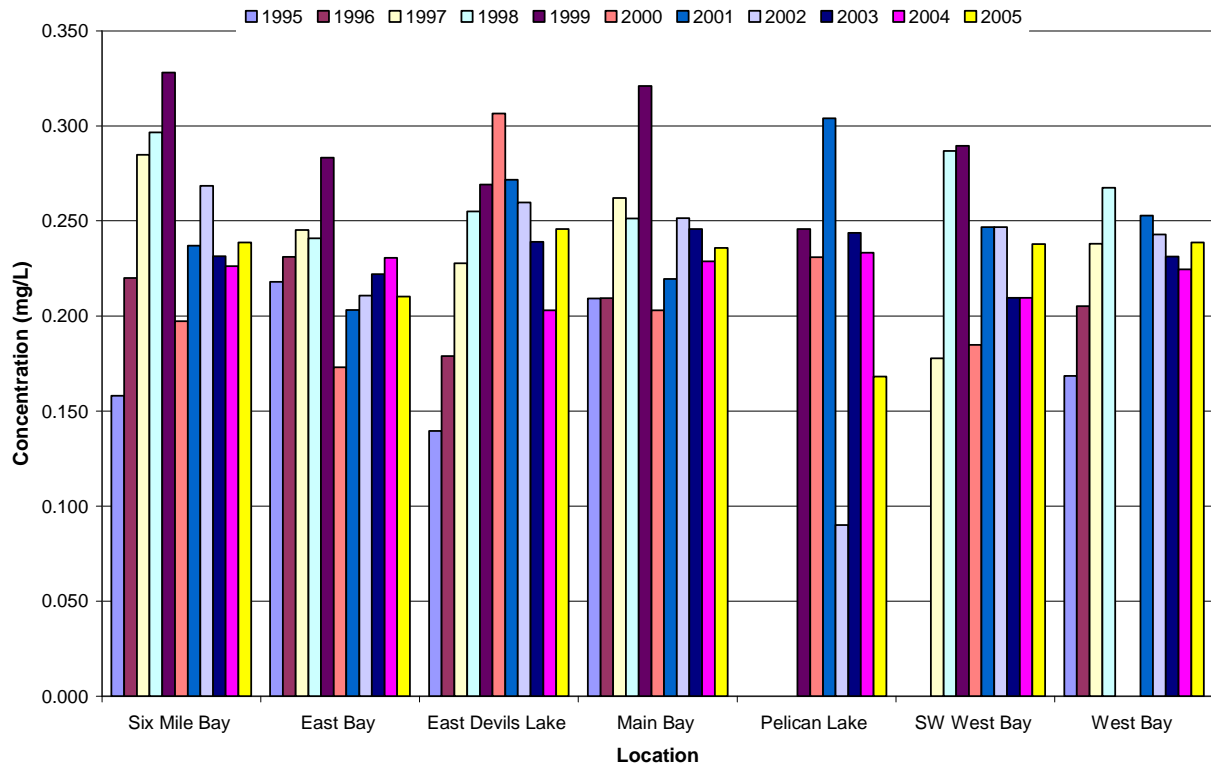

j) Chlorophyll - a

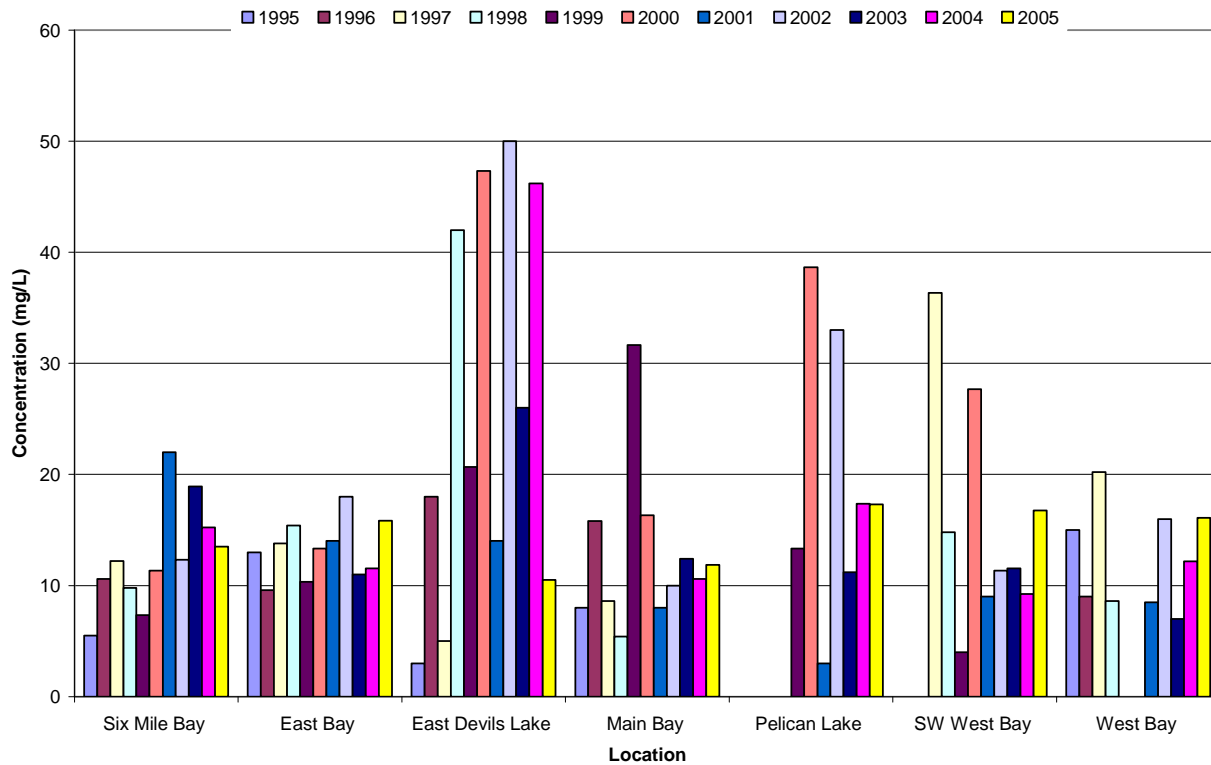


Figure 5. Continued

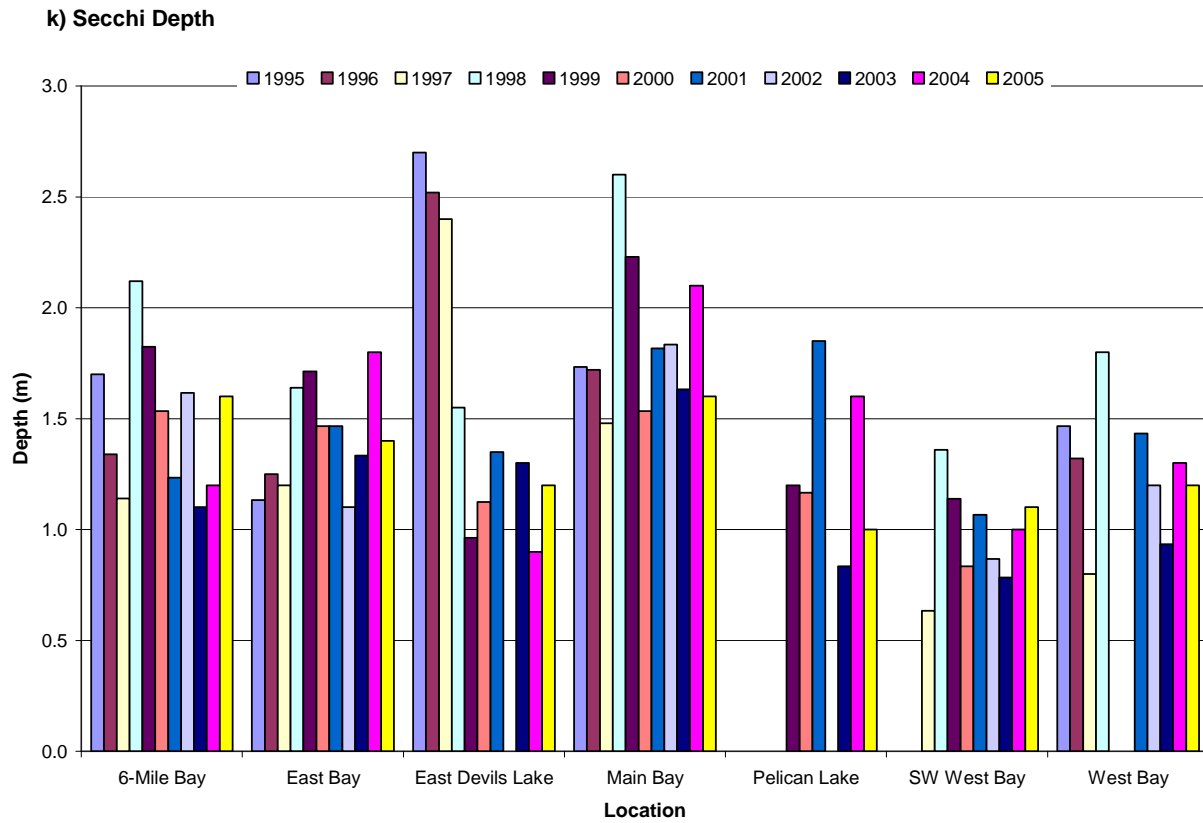


Figure 5. Continued

a) Six Mile Bay

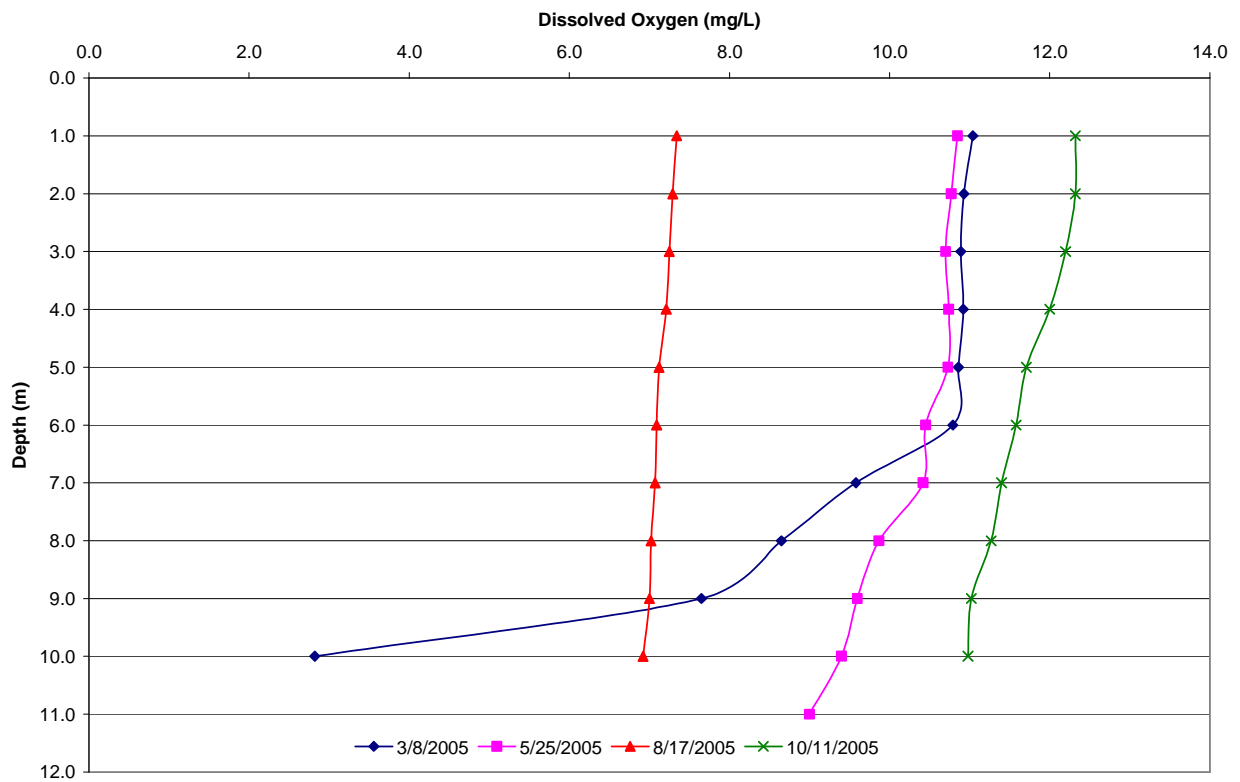
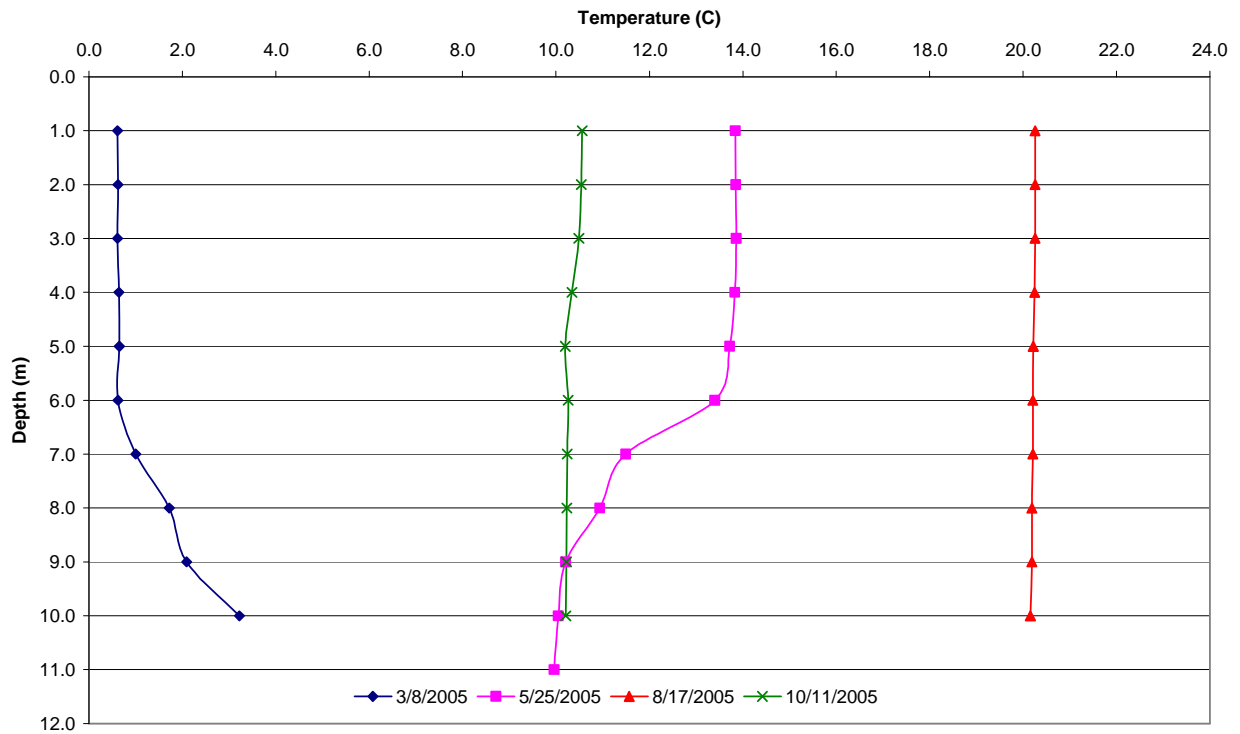


Figure 6. Temperature and Dissolved Oxygen Profiles for Each Devils Lake Sampling Site and Event in 2005

b) Main Bay

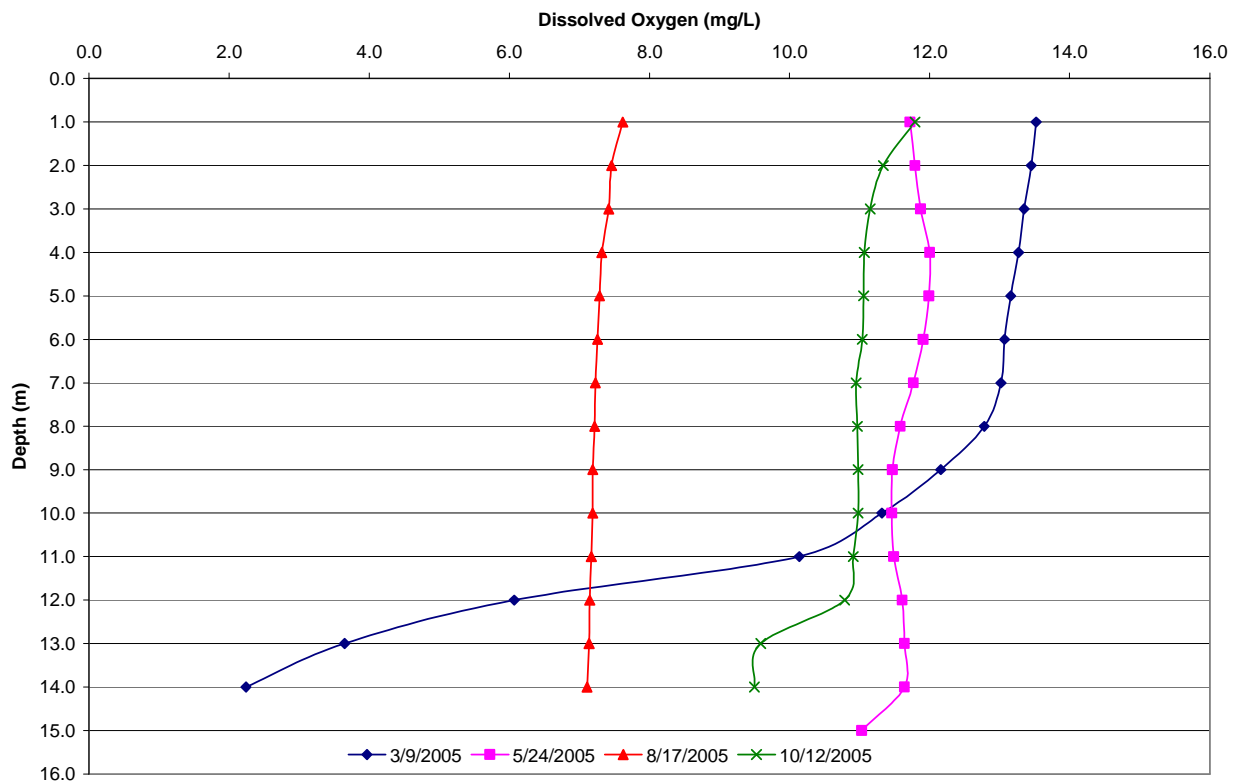
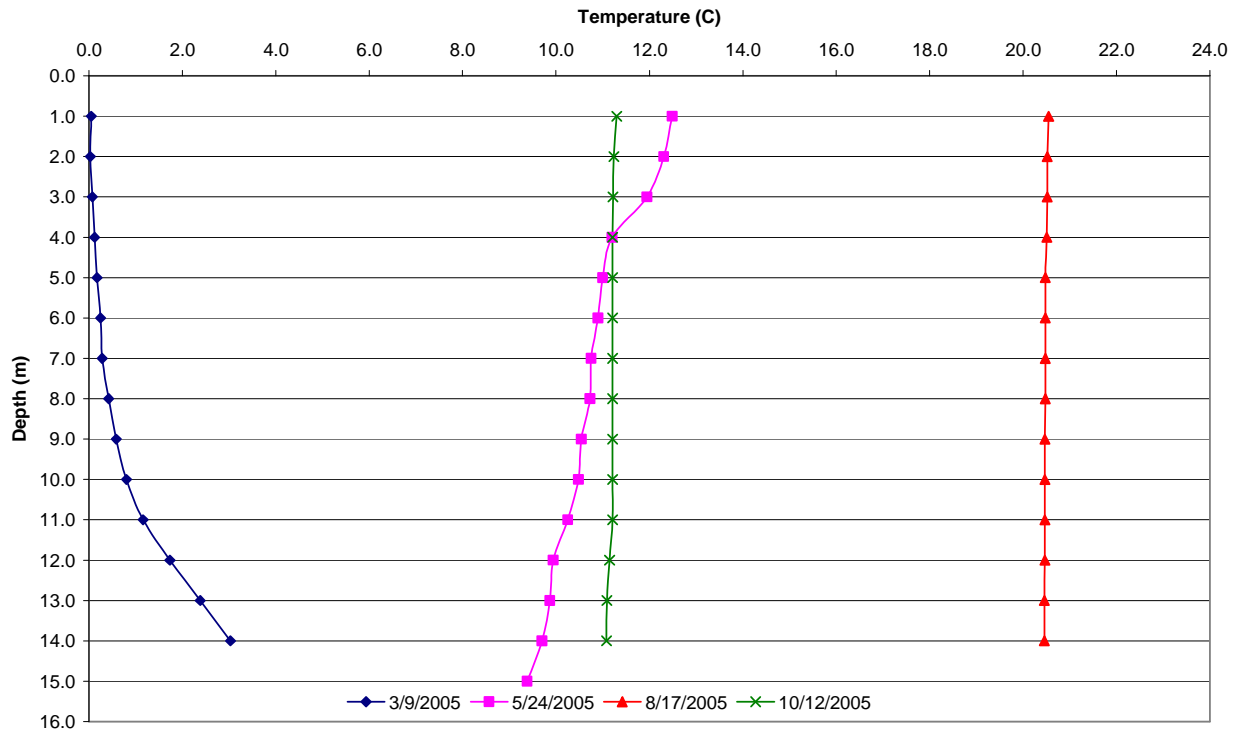


Figure 6. Continued

c) East Bay

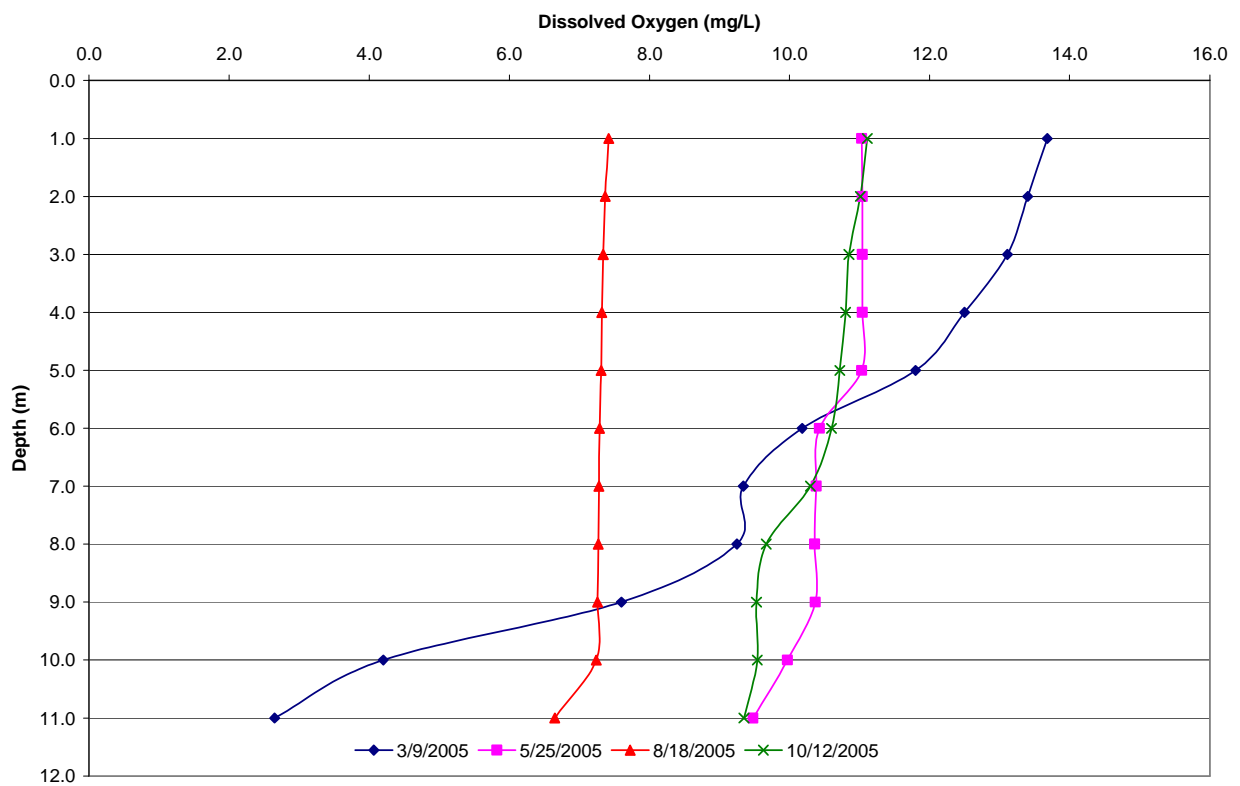
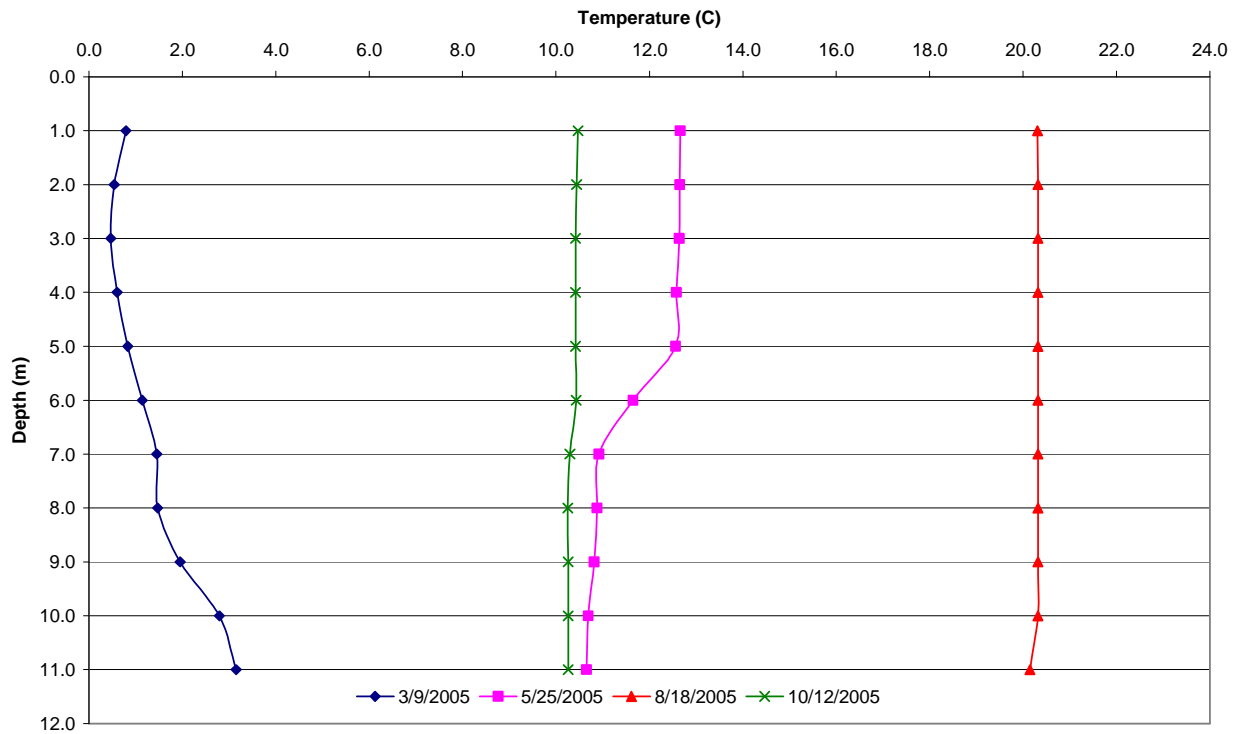


Figure 6. Continued

d) East Devils Lake

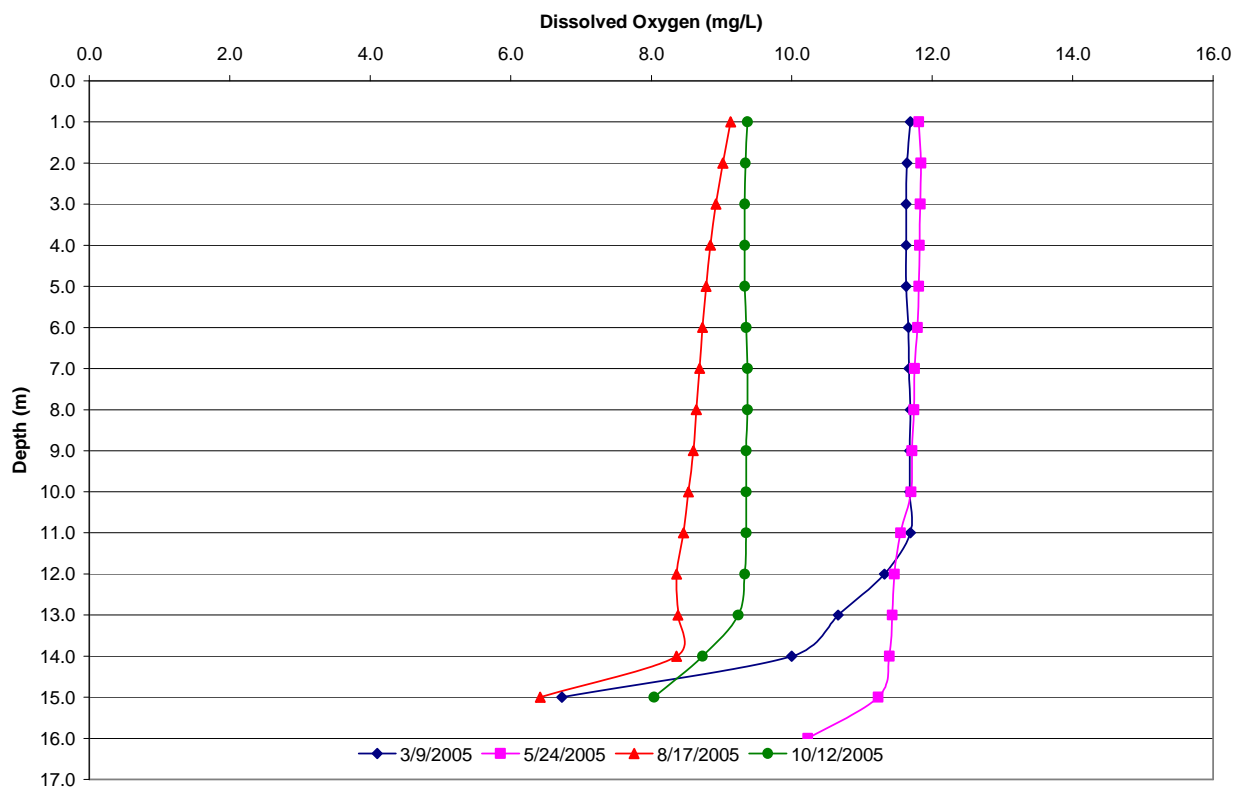
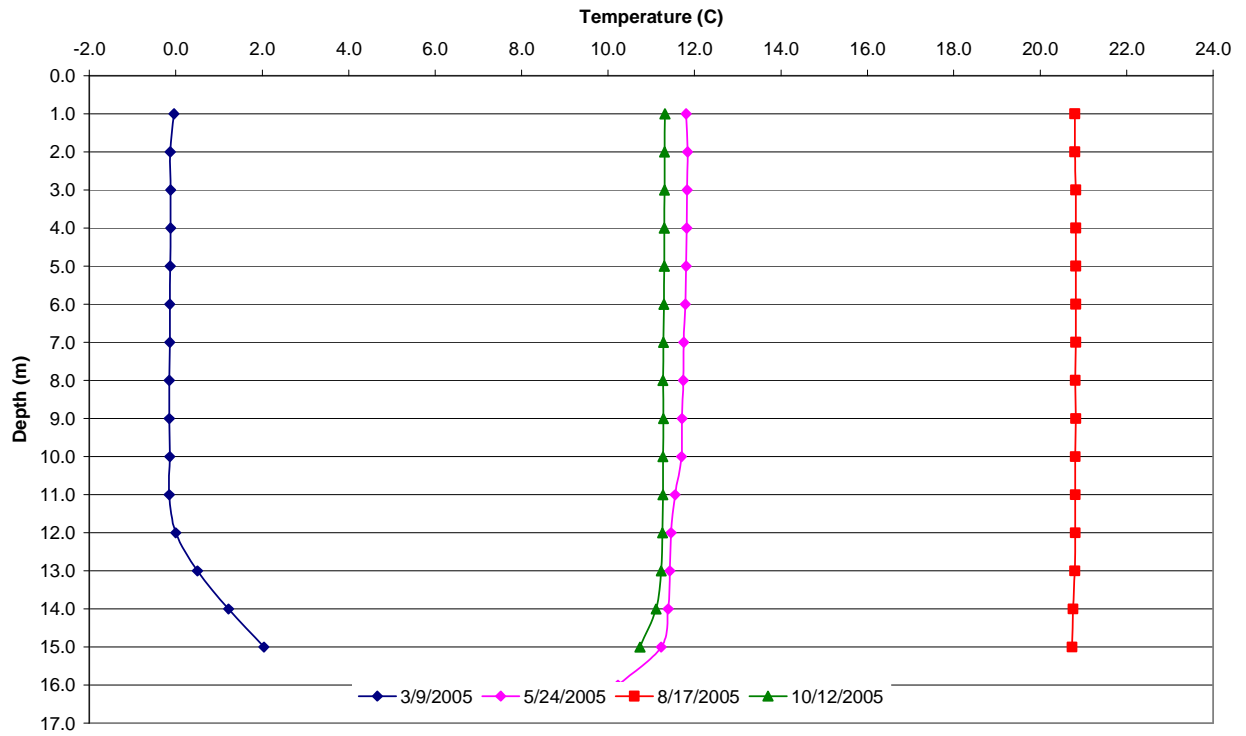


Figure 6. Continued

e) West Bay

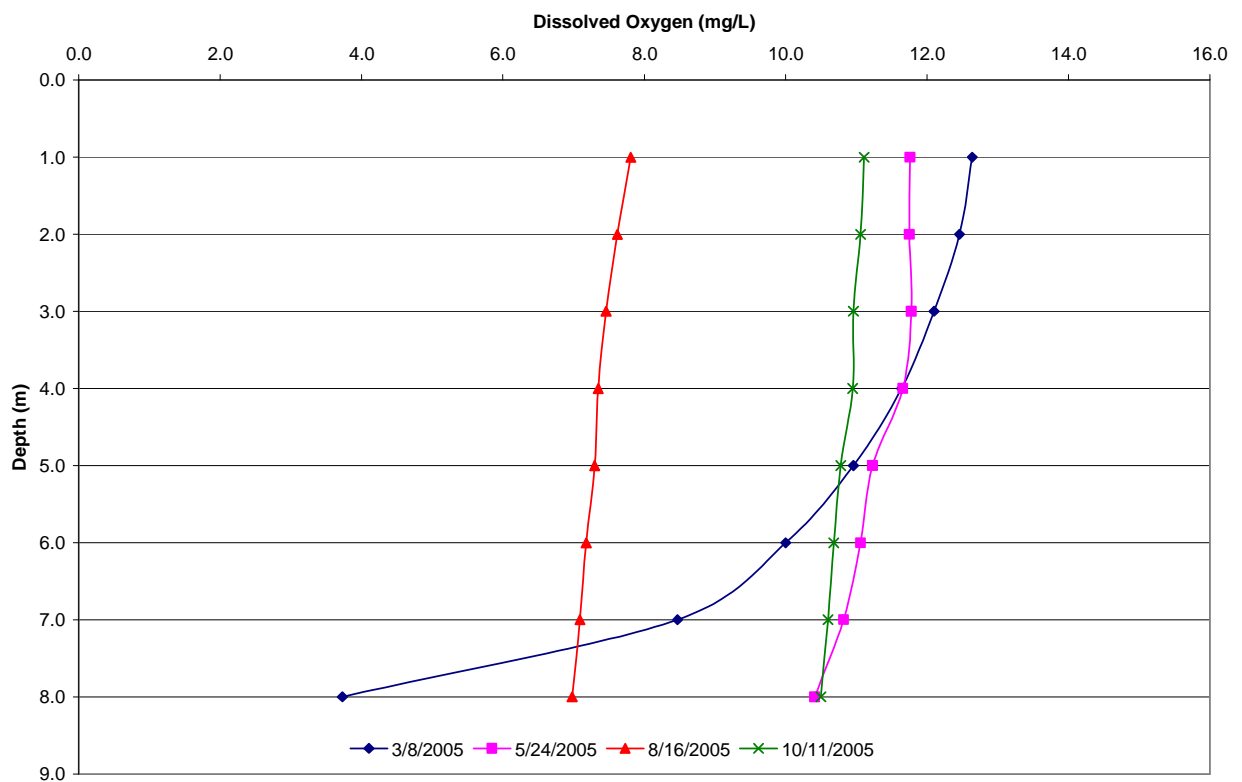
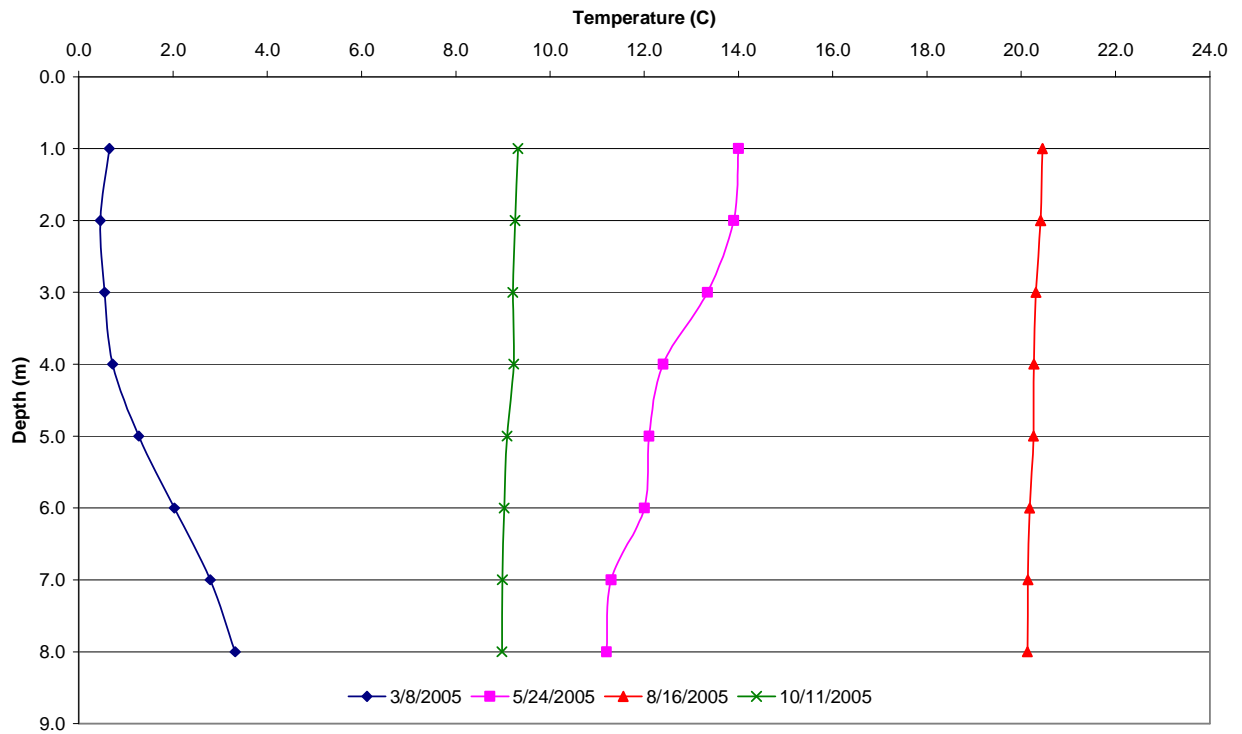


Figure 6. Continued

f) SW West Bay

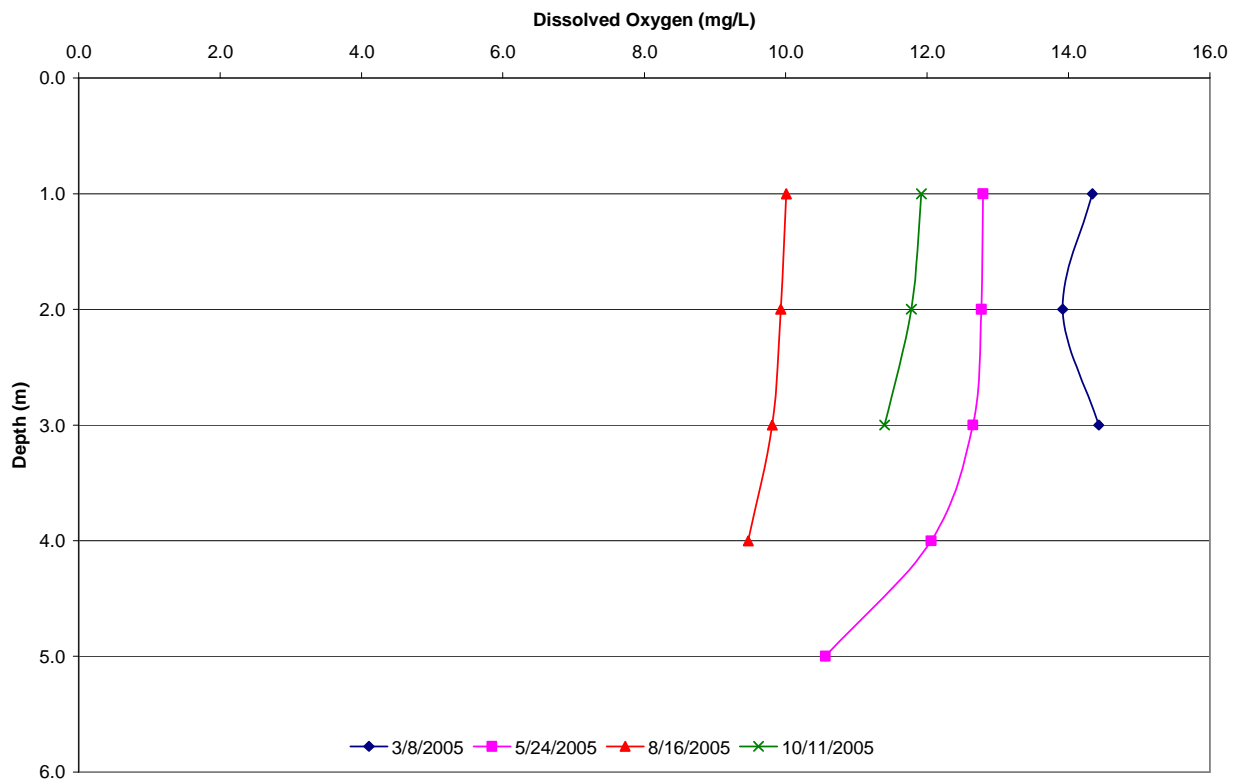
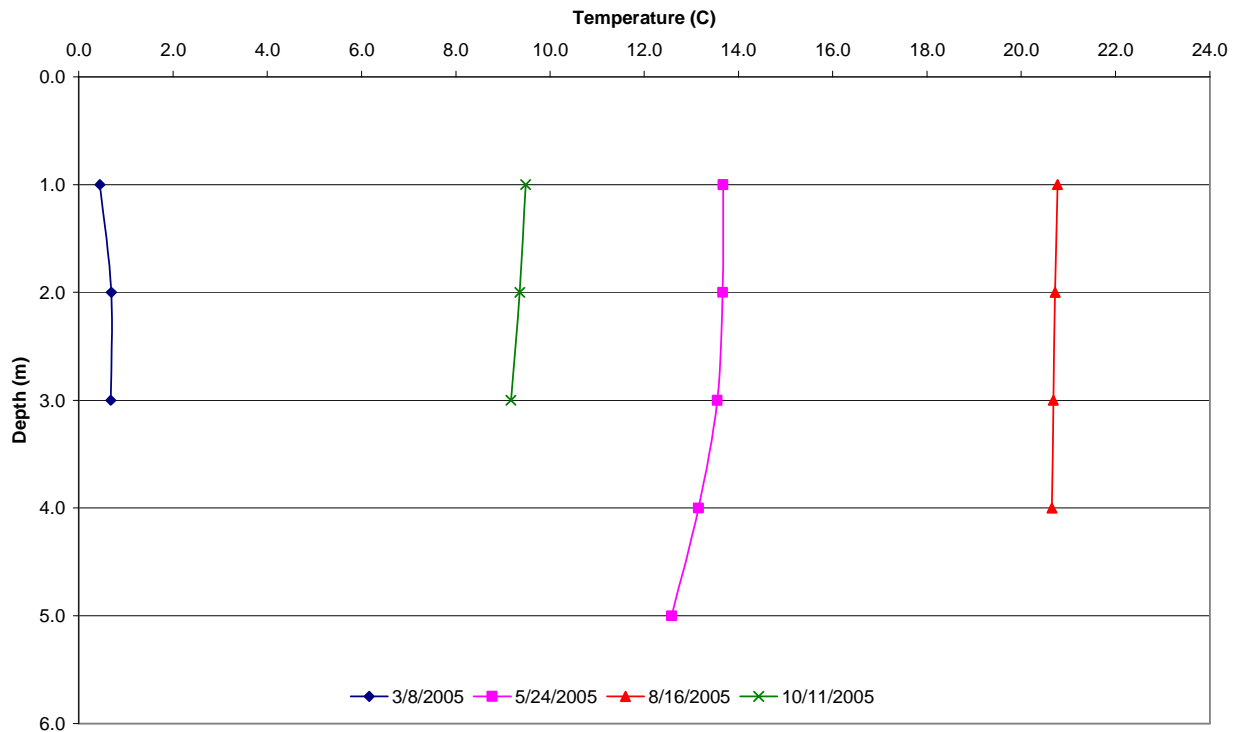


Figure 6. Continued

g) Pelican Lake

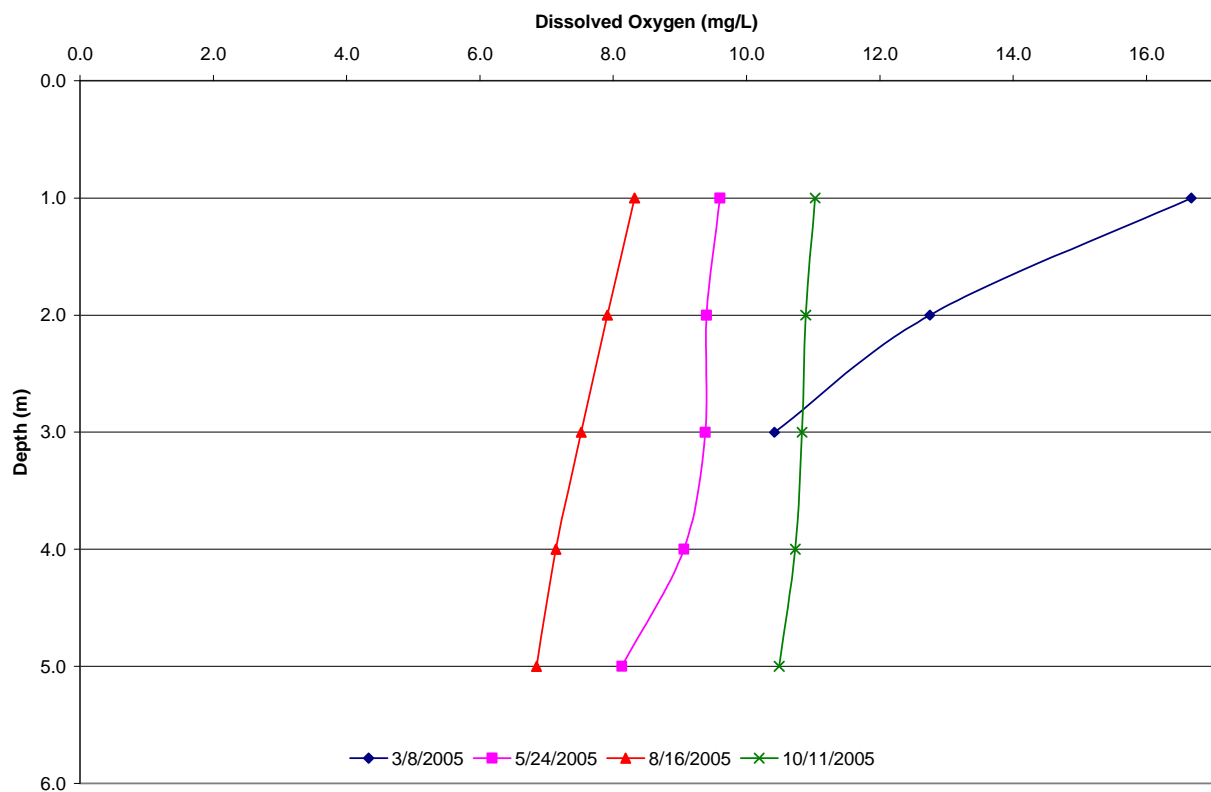
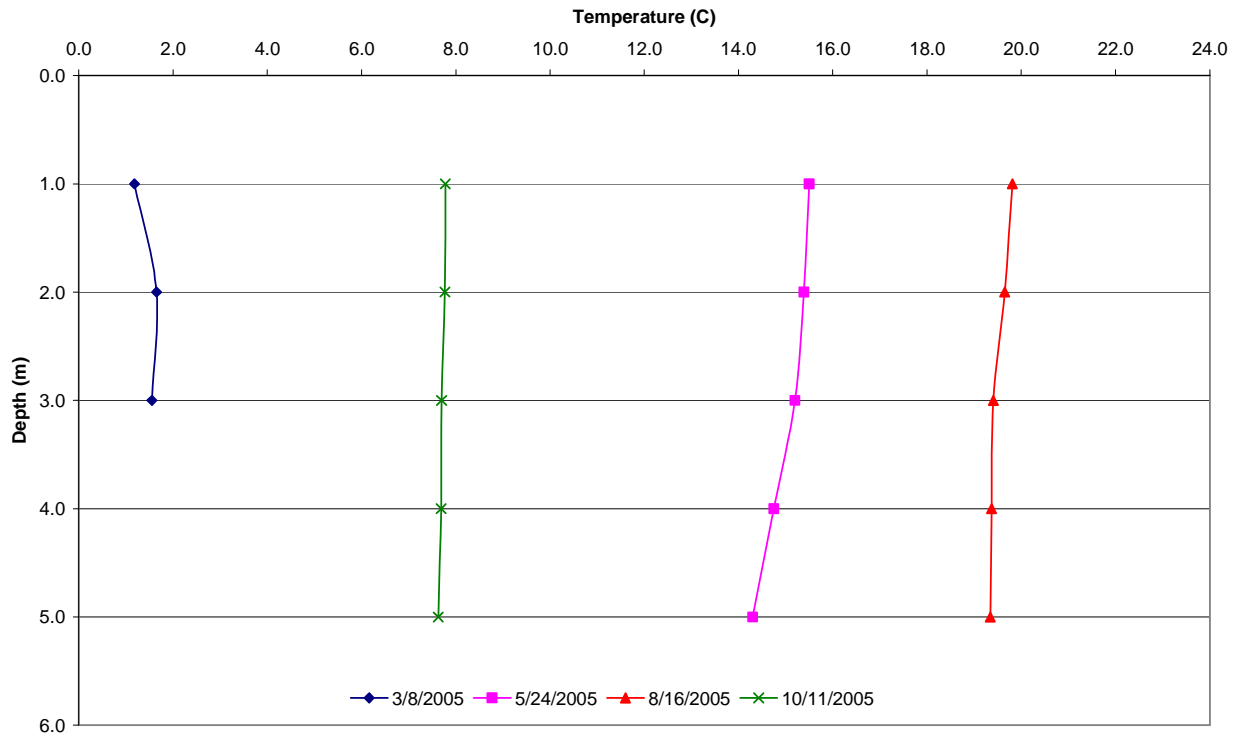


Figure 6. Continued

4.0 Literature Cited

North Dakota Department of Health. 2001. Standard Operating Procedures for Field Samplers. Surface Water Quality Management Program, Division of Water Quality, North Dakota Department of Health, Bismarck, ND.

North Dakota Department of Health. 2000. North Dakota State Department of Health Chemistry Division Quality Assurance Plan. Division of Chemistry, North Dakota Department of Health, Bismarck, ND.

United States Geological Survey. "Devils Lake Basin." <http://nd.water.usgs.gov/devilslake/>. December 2006.

Wiche, G., 1997. Personal communication, U.S. Geological Survey, Bismarck, North Dakota.

Appendix A
Water Quality Results for Devils Lake 1995-2005

Devils Lake Report

Analyte	Collection Date	Detect Limit	Depth	380221	380233	380234	380235	380236	384160	385029
Ammonia (N)										
	3/15/1995		1	0.258	0.214	0.18	0.39	0.281		
	5/15/1995		1	0.055	0.056	0.023	0.035	0.107		
	7/25/1995	0.010	1	0.09	0.059		0.033	*ND		
	7/27/1995		1			0.18				
	10/3/1995	0.010	1	*ND	*ND	*ND	0.041	*ND		
	3/25/1996	0.010	1	*ND	*ND	*ND		*ND		
	5/20/1996	0.010	1	*ND	*ND	0.016	0.012	0.021		
	6/4/1996		1	0.085	0.038	0.101	0.062	0.136		
	6/17/1996	0.010	1		*ND					
	7/1/1996	0.010	1	*ND	*ND	0.03	0.055	*ND		
	8/5/1996	0.010	1	*ND	*ND	*ND	*ND	*ND		
	9/3/1996	0.010	1	0.078	*ND	0.03	0.062	*ND		
	9/30/1996	0.010	1	0.056	*ND	*ND	0.151	*ND		
	3/4/1997		1	0.01	0.051	0.037	0.243	0.121		
	5/14/1997	0.010	1	0.061	0.029	*ND	0.042	*ND		
	7/8/1997	0.010	1	*ND	*ND	*ND		0.177		
	7/16/1997	0.010	1				*ND			
	8/4/1997	0.010	1	*ND	*ND	*ND	*ND	*ND	*ND	
	9/2/1997	0.010	1	0.035	0.022	0.029	0.088	*ND	0.05	
	10/6/1997	0.010	1	*ND	*ND	0.027		*ND	*ND	
	5/19/1998		1	0.047	0.156	0.099	0.058	0.167	0.098	
	7/6/1998	0.010	1	*ND	*ND	*ND	*ND	*ND	*ND	
	8/3/1998	0.010	1	0.085	0.033	0.064	*ND	0.047	0.021	
	9/8/1998	0.010	1	*ND	0.022	*ND		0.021	*ND	
	10/19/1998	0.010	1	0.081	0.075	*ND		0.038	0.032	
	10/21/1998		1				0.174			
	2/23/1999		1	0.154	0.104	0.057	0.162	0.095	0.056	
	5/25/1999		1	0.175	0.108	0.174	0.068		0.133	0.262
	8/2/1999	0.010	1	*ND	*ND	*ND	*ND	*ND	*ND	*ND
	10/11/1999	0.010	1	*ND	*ND	*ND	*ND	*ND	*ND	*ND
	2/14/2000		1	0.045	0.041	0.029	0.102		0.017	0.021
	5/2/2000	0.010	1	*ND	*ND	*ND	*ND		*ND	0.117
	8/1/2000	0.010	1	0.021	*ND	*ND	*ND		*ND	*ND
	10/9/2000	0.010	1	*ND	*ND	*ND	*ND	*ND	*ND	*ND
	3/19/2001		1	0.046	0.03	0.019	0.042	0.046	0.035	0.421
	5/14/2001	0.010	1	*ND	*ND	*ND	*ND	*ND	*ND	0.197
	8/6/2001		1	0.059	0.039	0.037	0.11	0.052	0.044	0.042

Analyte	Collection Date	Detect Limit	Depth	380221	380233	380234	380235	380236	384160	385029
	10/10/2001	0.010	1	0.036	0.011	0.03	0.188	*ND	0.013	0.028
	2/11/2002	0.010	1	*ND	*ND	*ND	0.119	*ND	*ND	0.075
	5/13/2002		1	0.046	0.027	0.017	0.051	0.116	0.038	0.021
	8/13/2002	0.010	1	0.013	0.031	*ND	0.011	*ND	*ND	*ND
	10/7/2002	0.010	1	*ND	*ND	*ND	*ND	*ND	*ND	*ND
	2/10/2003		1	0.098	0.063	0.16	0.323	0.06	0.12	0.327
	5/7/2003		1	0.021	0.013	0.052	0.063	0.022	0.012	0.06
	8/12/2003	0.010	1	*ND	0.079	*ND	0.017	0.042	*ND	*ND
	10/7/2003	0.010	1	*ND	*ND	*ND	0.218	*ND	*ND	*ND
	3/16/2004	0.010	1	*ND	*ND	*ND		*ND	*ND	*ND
	5/18/2004	0.010	1	*ND	*ND	*ND	*ND	*ND	*ND	0.114
	8/10/2004	0.010	1	*ND	*ND	*ND		*ND	*ND	*ND
	10/6/2004	0.010	1	*ND	*ND	*ND	*ND	*ND	*ND	*ND
	3/8/2005	0.010	1	*ND	*ND	*ND	*ND	*ND	*ND	*ND
	5/24/2005	0.010	1	*ND	*ND	*ND	0.016	*ND	*ND	0.129
	8/16/2005		1	0.094	0.103	0.062	0.078	0.042	0.024	0.078
	10/11/2005	0.010	1	*ND	*ND	*ND	0.11	*ND	*ND	*ND

Chloride

	3/15/1995		1	62	20.4	330	975	101		
	5/15/1995		1	104	182	379	858	91.5		
	7/25/1995		1	135	165	377	867	76.1		
	10/3/1995		1	151	161	362	840	93.1		
	3/25/1996		1	164	177	207		127		
	5/20/1996		1	110	155	292	741	108		
	6/4/1996		1	95.8	158	302	738	99		
	7/1/1996		1	97.2	141	321	788	94.8		
	8/5/1996		1	126	123	301	701	96.9		
	9/3/1996		1	137	148	330	816	95.8		
	9/30/1996		1	133	144	289	749	94.9		
	3/4/1997		1	146	150	251	860	131		
	5/14/1997		1	64.6	151	292	903	97.8		
	7/8/1997		1	112	127	248		79.6		
	7/16/1997		1				742			
	8/4/1997		1	111	129	278	721	85.3	71.6	
	9/2/1997		1	116	137	252	728	92.2	67.9	
	10/6/1997		1	118	136	254		88	82	
	5/19/1998		1	102	137	207	659	89.5	79.3	
	7/6/1998		1	105	122	210	565	89.7	84.4	
	8/3/1998		1	115	119	232	568	98.9	93.4	
	9/8/1998		1	111	125	238		97	99.3	
	10/19/1998		1	120	128	254	606	98.5	95.6	

Analyte

Collection Date	Detect Limit	Depth	380221	380233	380234	380235	380236	384160	385029
------------------------	---------------------	--------------	---------------	---------------	---------------	---------------	---------------	---------------	---------------

2/23/1999		1	130	140	277	631	123	118	
5/25/1999		1	93.3	121	249	573		85.9	18.6
8/2/1999		1	108	110	247	555		85.5	25.8
10/11/1999		1	116	119	252	570		94.7	20.9
2/14/2000		1	121	125	267	566		107	29.2
5/2/2000		1	115	118	243	545		97.9	55.8
8/1/2000		1	122	124	238	539		107	69.7
10/9/2000		1	125	124	243	520	108	108	73.3
3/19/2001		1	128	124	199	436	120	121	33.2
5/14/2001		1	83	126	250	487	115	108	38
8/6/2001		1	113	117	221	497	109	103	59.1
10/10/2001		1	121	126	236	526	114	112	59.8
2/11/2002		1	126	127	226	513	126	124	62.5
5/13/2002		1	112	107	212	401	110	93.3	63.1
8/13/2002		1	116	125	219	480	117	115	83
10/7/2002		1	126	136	212	457	126	125	41.7
2/10/2003		1	134	140	248	487	138	139	109
5/7/2003		1	101	122	191	442	123	113	77.8
8/12/2003		1	130	131	210	433	120	118	92.1
10/7/2003		1	131	129	211	462	122	120	106
3/16/2004		1	145	153	200		147	158	131
5/18/2004		1	106	130	205	398	120	117	73.4
8/10/2004		1	123	99.7	207		116	120	75.1
10/6/2004		1	123	131	210	395	120	118	81.3
3/8/2005		1	126	133	195	389	130	132	94.6
5/24/2005		1	122	130	195	347	117	125	77.8
8/16/2005		1	112	126	196	332	115	119	68.6
10/11/2005		1	121	123	191	309	120	119	71.8

Chlorophyll A

7/25/1995	3.000	0	8	13		*ND	21		
7/27/1995		0			23				
10/3/1995	3.000	0	*ND	*ND	*ND	*ND	9		
5/20/1996	3.000	0	16	5	7	15	*ND		
6/4/1996	3.000	1	*ND	*ND	*ND	*ND	*ND		
7/1/1996	3.000	0	6	52	*ND	*ND	14		
8/5/1996		0	9	12	22	25	11		
9/3/1996		0	19	16	11	11	6		
9/30/1996	3.000	0	*ND	*ND			11		
10/2/1996		0			5	36			
5/14/1997	3.000	0	23	14	10	*ND	19		
7/8/1997	3.000	0	*ND	*ND	36		6		

Analyte	Collection Date	Detect Limit	Depth	380221	380233	380234	380235	380236	384160	385029
	7/16/1997		0				4			
	8/4/1997	3.000	0	11	7	6	*ND	42	42	
	9/2/1997		0	15	9	12	10	19	25	
	10/6/1997		0	9	10	5		15	42	
	5/19/1998	3.000	0	6	*ND	*ND	5	*ND	*ND	
	7/6/1998	3.000	0	18	*ND	11	*ND	7	11	
	8/3/1998		0	9	12	16	140	18	21	
	9/8/1998	3.000	0	13	5			*ND		
	9/10/1998		0			18			19	
	10/19/1998	3.000	0	*ND	4	29	20	12	20	
	5/25/1999	3.000	0	*ND	*ND	*ND	*ND		*ND	*ND
	8/2/1999	3.000	0	*ND	16	5	*ND		*ND	9
	10/11/1999	6.000	0	16	76	23	56		*ND	28
	5/2/2000	3.000	0	8	11	9	24		9	*ND
	8/1/2000		0	16	14	12	77		57	78
	10/9/2000		0	10	24	19	41	11	17	35
	5/14/2001	6.000	0	30	14			*ND	*ND	
	5/15/2001	3.000	0			9	20			*ND
	10/10/2001		0	14	7	19	8	11	12	
	5/13/2002	3.000	0	*ND	*ND	8	9	*ND	6	22
	8/13/2002		0	23	15	36	108	27	16	35
	10/7/2002		0	11	9	10	33	18	12	42
	5/7/2003		0	7	6	11	4	7	9	5
	8/12/2003		0	37	4	16	58	8	20	19
	10/7/2003	6.000	0	12.8	15	*ND	16	*ND	5.7	9.6
	5/18/2004	3.000	0	11.5	9.1	5.3	32.6	*ND	5.6	*ND
	8/10/2004		0	14.7	6.7	11.9		13.2	20	45.9
	10/6/2004		0	19.5	16	17.4	59.8	20.3	2.1	3.2
	5/24/2005		0	3.6	2.7	3.5	4.3	6.5	6.8	2.5
	8/16/2005		0	10.7	13.1	22.7	20.3	15.5	24.6	24.3
	10/11/2005		0	26.2	19.8	21.4	6.9	26.3	18.9	25.1
Conductivity										
	3/15/1995		1	1040	3060	4480	11000	2100		
	5/15/1995		1	1800	2830	4780	9900	1700		
	7/25/1995		1	2270	2410	4790	9650	1500		
	10/3/1995		1	2410	2560	4820	9920	1760		
	3/25/1996		1	2660	2730	3140		2100		
	5/20/1996		1	1870	2450	4180	8980	1870		
	6/4/1996		1	1740	2440	4270	9170	1800		
	7/1/1996		1	1830	2330	4300	9270	1760		
	8/5/1996		1	2060	2280	4130	8950	1720		

Analyte	Collection Date	Detect Limit	Depth	380221	380233	380234	380235	380236	384160	385029
	9/3/1996		1	2180	2310	4280	9070	1730		
	9/30/1996		1	2250	2400	4320	9370	1800		
	3/4/1997		1	2490	2540	3670	9820	2360		
	5/14/1997		1	1250	2320	3860	8920	1710		
	7/8/1997		1	1900	2090	3410		1530		
	7/16/1997		1				8380			
	8/4/1997		1	1840	2050	3350	8210	1540	1360	
	9/2/1997		1	1820	2080	3290	8310	1600	1440	
	10/6/1997		1	1950	2160	3330		1650	1580	
	5/19/1998		1	1890	2130	3150	8020	1740	1620	
	7/6/1998		1	1940	2130	3280	7530	1780	1700	
	8/3/1998		1	1990	2120	3400	7390	1810	1750	
	9/8/1998		1	1960	2100	3390		1860	1790	
	10/19/1998		1	2060	2130	3480	7230	1850	1800	
	2/23/1999		1	2190	2240	3720	7510	2120	2120	
	5/25/1999		1	1670	2000	3100	6750		1600	702
	8/2/1999		1	1900	1920	3310	6720		1640	864
	10/11/1999		1	1930	1970	3350	6710		1730	932
	2/14/2000		1	2080	2110	3580	6810		1940	1310
	5/2/2000		1	2000	2030	3380	6530		1780	1300
	8/1/2000		1	2000	2020	3290	6480		1810	1420
	10/9/2000		1	2120	2130	3360	6610	1930	1960	1250
	3/19/2001		1	2290	2260	3150	5950	2250	2310	1120
	5/14/2001		1	1540	2020	3240	5860	1980	1890	1070
	8/6/2001		1	1960	2010	3170	6000	1930	1880	1290
	10/10/2001		1	2050	2110	3240	6150	2000	1990	1330
	2/11/2002		1	2210	2200	3450	6380	2190	2240	1610
	5/13/2002		1	2080	2130	3200	5890	2000	1960	1520
	8/13/2002		1	2040	2170	3250	5970	2080	2070	1700
	10/7/2002		1	2080	2160	3160	5700	2050	2060	1250
	2/10/2003		1	2250	2300	3430	6010	2310	2360	2070
	5/7/2003		1	1920	2210	3000	5860	2140	2090	1690
	8/12/2003		1	2200	2250	3150	5730	2140	2110	1880
	10/7/2003		1	2250	2290	3160	5740	2170	2180	1930
	3/16/2004		1	2320	2410	2930		2390	2460	2200
	5/18/2004		1	1900	2210	3090	5300	2090	2090	1520
	8/10/2004		1	2090	2140	3010		2070	2050	1540
	10/6/2004		1	2150	2210	3060	5220	2110	2090	1650
	3/8/2005		1	2260	2360	3140	5200	2320	2370	2000
	5/24/2005		1	2140	2190	2970	4550	2090	2100	1660
	8/16/2005		1	1940	2120	2900	4310	2070	2060	1500
	10/11/2005		1	2110	2170	2940	4280	2120	2110	1590

Analyte	Collection Date	Detect Limit	Depth	380221	380233	380234	380235	380236	384160	385029
---------	-----------------	--------------	-------	--------	--------	--------	--------	--------	--------	--------

Dissolved Phosphorus as P

3/15/1995	1						0.176	0.277		
7/25/1995	1	0.253		0.222	0.254	0.13	0.188			
10/3/1995	1	0.197		0.202	0.267	0.179	0.139			
3/25/1996	1	0.201		0.148	0.173		0.253			
5/20/1996	1	0.131		0.166	0.193	0.115	0.139			
6/4/1996	1	0.183		0.188	0.241	0.167	0.222			
6/17/1996	1			0.183						
7/1/1996	1	0.244		0.193	0.261	0.187	0.206			
8/5/1996	1	0.24		0.25	0.295	0.179	0.271			
9/3/1996	1	0.228		0.241	0.233	0.2	0.238			
9/30/1996	1	0.276		0.258	0.232	0.214	0.124			
3/4/1997	1	0.282		0.243	0.291	0.261	0.143			
5/14/1997	1	0.294		0.304	0.216	0.312	0.249			
7/8/1997	1	0.299		0.242	0.261		0.223			
7/16/1997	1					0.185				
8/4/1997	1	0.256		0.229	0.234	0.157	0.295	0.173		
9/2/1997	1	0.318		0.306	0.254	0.224	0.3	0.238		
10/6/1997	1	0.26		0.248	0.216		0.218	0.122		
5/19/1998	1	0.22		0.23	0.223	0.256	0.218	0.206		
7/6/1998	1	0.194		0.193	0.179	0.272	0.186	0.205		
8/3/1998	1	0.341		0.276	0.3	0.22	0.352	0.322		
9/8/1998	1	0.29		0.296	0.29		0.352	0.318		
10/19/1998	1	0.438		0.262	0.212	0.272	0.229	0.383		
2/23/1999	1	0.469		0.486	0.413	0.294	0.431	0.404		
5/25/1999	1	0.265		0.296	0.244	0.317		0.317	0.25	
8/2/1999	1	0.315		0.258	0.3	0.242		0.276	0.334	
10/11/1999	1	0.263		0.244	0.176	0.224		0.161	0.153	
2/14/2000	1	0.156		0.177	0.157	0.338		0.148	0.106	
5/2/2000	1	0.173		0.181	0.16	0.3		0.173	0.205	
8/1/2000	1	0.206		0.249	0.193	0.268		0.221	0.38	
10/9/2000	1	0.254		0.205	0.182	0.32	0.208	0.197	0.233	
3/19/2001	1	0.179		0.155	0.197	0.325	0.181	0.199	0.315	
5/14/2001	1	0.207		0.162	0.165	0.203	0.208	0.194	0.26	
8/6/2001	1	0.27		0.262	0.223	0.231	0.32	0.296	0.337	
10/10/2001	1	0.292		0.299	0.228	0.328	0.302	0.298	0.058	
2/11/2002	1	0.206		0.237	0.172	0.26	0.21	0.211	0.008	
5/13/2002	1	0.331		0.237	0.194	0.279	0.241	0.227	0.056	
8/13/2002	1	0.298		0.287	0.244	0.257	0.286	0.268	0.256	
10/7/2002	1	0.239		0.245	0.233	0.243	0.235	0.281	0.04	

Analyte	Collection Date	Detect Limit	Depth	380221	380233	380234	380235	380236	384160	385029
	2/10/2003		1	0.197	0.215	0.23	0.351	0.218	0.194	0.274
	5/7/2003		1	0.186	0.224	0.213		0.224	0.212	0.199
	8/12/2003		1	0.265	0.29	0.224	0.153	0.316	0.258	0.309
	10/7/2003		1	0.278	0.254	0.221	0.175	0.167	0.174	0.193
	3/16/2004		1	0.208	0.169	0.203		0.2	0.18	0.282
	5/18/2004		1	0.176	0.187	0.185	0.146	0.179	0.161	0.233
	8/10/2004		1	0.273	0.302	0.275		0.283	0.254	0.269
	10/6/2004		1	0.248	0.257	0.259	0.26	0.236	0.243	0.149
	3/8/2005		1	0.241	0.225	0.227	0.277	0.251	0.241	0.128
	5/24/2005		1	0.192	0.203	0.188	0.245	0.174	0.18	0.166
	8/16/2005		1	0.306	0.29	0.232	0.237	0.281	0.276	0.233
	10/11/2005		1	0.216	0.225	0.194	0.224	0.249	0.254	0.146
Dissolved Solids(C)-Total										
	3/15/1995		1	638	1890	3090	9000	1400		
	5/15/1995		1	1070	1840	3270	7570	1000		
	7/25/1995		1	1440	1880	3410	8120	960		
	10/3/1995		1	1760	1870	3600	8160	1280		
	3/25/1996		1	1890	1790	2260		1350		
	5/20/1996		1	1090	1500	2750	7650	1110		
	6/4/1996		1	1110	1640	3040	7750	1140		
	7/1/1996		1	1150	1530	3060	7520	1110		
	8/5/1996		1	1290	1450	2910	7300	1110		
	9/3/1996		1	1470	1720	3450	7030	1080		
	9/30/1996		1	1380	1490	2850	6660	1090		
	3/4/1997		1	1790	1550	2610	8200	1450		
	5/14/1997		1	812	1660	2910	7860	1160		
	7/8/1997		1	1250	1370	2430		981		
	7/16/1997		1				6740			
	8/4/1997		1	1300	1490	2570	6860	1090	944	
	9/2/1997		1	1200	1400	2280	6640	1020	902	
	10/6/1997		1	1300	1440	2350		1080	1010	
	5/19/1998		1	1230	1360	2140	6310	1100	1050	
	7/6/1998		1	1260	1390	2170	5620	1130	1090	
	8/3/1998		1	1290	1340	2240	5500	1150	1110	
	9/8/1998		1	1310	1440	2380		1250	1160	
	10/19/1998		1	1430	1460	2480	5730	1210	1190	
	2/23/1999		1	1480	1490	2750	6080	1490	1450	
	5/25/1999		1	1130	1390	2340	5430		1090	447
	8/2/1999		1	1290	1300	2380	5380		1110	564
	10/11/1999		1	1340	1360	2460	5450		1140	596
	2/14/2000		1	1440	1470	2590	5410		1330	865

Analyte	Collection Date	Detect Limit	Depth	380221	380233	380234	380235	380236	384160	385029
	5/2/2000		1	1360	1420	2450	5180		1230	851
	8/1/2000		1	1400	1420	2380	5110		1250	936
	10/9/2000		1	1400	1440	2420	4990	1310	1300	1020
	3/19/2001		1	1540	1500	2180	4540	1470	1510	721
	5/14/2001		1	1050	1440	2350	4590	1380	1310	699
	8/6/2001		1	1360	1410	2240	4700	1340	1290	854
	10/10/2001		1	1430	1480	2420	4930	1370	1350	877
	2/11/2002		1	1540	1520	2400	4800	1530	1540	1030
	5/13/2002		1	1380	1320	2210	4050	1340	1230	945
	8/13/2002		1	1360	1490	2280	4550	1460	1460	1090
	10/7/2002		1	1370	1490	2220	4290	1500	1450	822
	2/10/2003		1	1580	1630	2520	4440	1630	1660	1440
	5/7/2003		1	1240	1440	2010	4170	1420	1360	1060
	8/12/2003		1	1500	1500	2190	4180	1420	1400	1220
	10/7/2003		1	1540	1540	2280	4250	1480	1470	1290
	3/16/2004		1	1660	1710	2190		1690	1770	1580
	5/18/2004		1	1270	1480	2140	3830	1410	1390	992
	8/10/2004		1	1420	1300	2140		1400	1420	1050
	10/6/2004		1	1470	1510	2170	3840	1440	1430	1090
	3/8/2005		1	1530	1590	2170	3830	1570	1590	1350
	5/24/2005		1	1430	1490	2060	3430	1400	1460	1080
	8/16/2005		1	1350	1460	2080	3300	1380	1420	1000
	10/11/2005		1	1430	1460	2050	3130	1440	1430	1050

Nitrate + Nitrite (N)

	3/25/1996		1	0.11	0.04	0.07		0.27		
	5/20/1996	0.020	1	*ND	*ND	*ND	*ND	*ND		
	6/4/1996	0.020	1	*ND	*ND	0.02	0.03	0.05		
	6/17/1996	0.020	1		*ND					
	7/1/1996	0.020	1	0.03	*ND	0.03	0.06	0.02		
	8/5/1996	0.020	1	*ND	*ND	*ND	*ND	*ND		
	9/3/1996	0.020	1	*ND	*ND	*ND	*ND	*ND		
	9/30/1996	0.020	1	0.19	0.08			*ND		
	10/2/1996		1			0.04	0.06			
	3/4/1997		1	0.5	0.24	0.33	0.26	0.09		
	5/14/1997	0.020	1	0.29	0.11	*ND	0.51	*ND		
	7/8/1997		1	0.06	0.04	0.02		0.05		
	7/16/1997	0.020	1				*ND			
	8/4/1997	0.020	1	*ND	*ND	*ND	*ND	*ND	*ND	
	9/2/1997		1	0.04	0.03	0.02	0.03	0.05	0.07	
	10/6/1997		1	0.19	0.15	0.1		0.13	0.11	
	5/19/1998		1	0.1	0.08		0.57			

Analyte	Collection Date	Detect Limit	Depth	380221	380233	380234	380235	380236	384160	385029
	7/6/1998	0.020	1	*ND	*ND	*ND	0.37	0.04	0.08	
	8/3/1998	0.020	1	0.03	*ND	*ND	*ND	0.03	*ND	
	9/8/1998	0.020	1	*ND	*ND	*ND		0.04	0.03	
	10/19/1998	0.020	1	*ND	0.07	0.02		0.06	0.02	
	10/21/1998		1				0.21			
	2/23/1999	0.020	1	0.3	0.2	0.13	0.46	0.05	*ND	
	5/25/1999		1	0.22	0.13	0.05	0.48		0.11	0.22
	8/2/1999	0.020	1	*ND	*ND	*ND	*ND		*ND	*ND
	10/11/1999	0.020	1	0.09	*ND	*ND	0.12		*ND	0.26
	2/14/2000	0.020	1	0.06	*ND	0.02	0.48		*ND	*ND
	5/2/2000	0.020	1	*ND	*ND	*ND	0.48		*ND	0.03
	8/1/2000	0.020	1	0.02	*ND	*ND	*ND		*ND	*ND
	10/9/2000		1	0.2	0.04	0.19	0.26	0.09	0.02	0.02
	3/19/2001		1	0.11	0.05	0.27	0.51	0.07	0.09	0.66
	5/14/2001	0.020	1	0.36	*ND	*ND	0.02	0.04	*ND	0.06
	8/6/2001	0.020	1	*ND	*ND	*ND	0.03	*ND	*ND	0.02
	10/10/2001		1	0.07	0.08	0.08	0.08	0.03	0.03	0.09
	2/11/2002		1	0.22	0.19	0.32	0.46	0.14	0.06	0.04
	5/13/2002	0.020	1	0.06	0.07	0.09	0.48	0.06	*ND	0.02
	8/13/2002	0.020	1	0.02	0.04	0.03	0.03	*ND	0.02	0.06
	10/7/2002		1	0.02	0.02	0.15	0.1	0.02	0.07	0.02
	2/10/2003		1	0.03	0.02	0.23	0.31	0.02	0.02	0.11
	5/7/2003	0.020	1	0.02	*ND	0.05	0.48	*ND	*ND	0.04
	8/12/2003	0.020	1	*ND	*ND	*ND	*ND	0.02	*ND	*ND
	10/7/2003		1	0.04	0.04	0.08	0.11	0.02	0.03	0.02
	3/16/2004	0.020	1	0.21	*ND			0.14	0.09	
	3/18/2004		1			0.14				0.35
	5/18/2004		1	0.07	0.02	0.04	0.23	0.05	0.12	0.05
	8/10/2004		1	0.03	0.04	0.02		0.04	0.03	0.02
	10/6/2004	0.020	1	0.02	*ND	0.05	0.06	0.02	0.03	0.02
	3/8/2005		1	0.04	0.02	0.02	0.36	0.02	0.02	0.02
	5/24/2005		1	0.02	0.02	0.02	0.28	0.02	0.03	0.15
	8/16/2005	0.020	1	0.15	0.03	0.02	*ND	0.03	*ND	0.05
	10/11/2005	0.020	1	*ND	*ND	*ND	0.09	0.04	0.02	0.04
Nitrogen (Total)										
	5/19/1998		1	1.83	1.95		4			
	7/6/1998		1	1.5	1.1	1.61	2.83	1.11	1.32	
	8/3/1998		1	1.42	1.33	1.8	3.12	1.59	1.55	
	9/8/1998		1	1.35	1.54	2.25		1.44	1.4	
	10/19/1998		1	1.52	1.53	1.8	2.98	1.21	1.14	
	2/23/1999		1	1.81	1.59	2.1	3.62	1.43	1.51	

Analyte	Collection Date	Detect Limit	Depth	380221	380233	380234	380235	380236	384160	385029
	5/25/1999		1	1.67	1.6	1.94	3.14		2.02	1.5
	8/2/1999		1	1.34	1.18	1.49	2.3		1.26	1.05
	10/11/1999		1	1.23	1.18	1.53	2.87		1.12	1.4
	2/14/2000		1	1.49	1.37	1.98	3.31		1.46	2.3
	5/2/2000		1	1.4	1.3	1.93	3.3		1.41	1.64
	8/1/2000		1	1.71	1.52	2.01	3.02		1.98	2.35
	10/9/2000		1	1.61	1.42	2.17	4.02	1.58	1.52	1.64
	3/19/2001		1	1.66	1.51	2.12	3.34	1.69	2.01	2.54
	5/14/2001		1	1.7	1.45	1.95	2.46	1.47	1.51	1.56
	8/6/2001		1	2.09	1.97	2.48	3.74	1.8	2.17	2.55
	10/10/2001		1	1.54	1.52	1.88	2.76	1.54	1.59	1.53
	2/11/2002		1	1.83	1.46	2.38	4.45	1.47	1.49	1.93
	5/13/2002		1	1.38	1.37	1.8	2.84	1.53	1.53	1.48
	8/13/2002		1	1.09	1.35	1.61	2.42	1.09	1.02	1.23
	10/7/2002		1	1.39	1.25	1.87	2.42	1.27	1.25	1.08
	2/10/2003		1	1.57	1.65	2.13	3.19	1.64	1.77	2.08
	5/7/2003		1	1.44	1.48	1.99	3.17	1.6	1.59	1.7
	8/12/2003		1	1.58	1.55	1.97	2.99	1.46	1.77	1.39
	10/7/2003		1	1.61	1.61	1.73	3.02	1.43	1.5	1.85
	3/16/2004		1	1.6	1.42	1.69		1.46	1.62	1.98
	5/18/2004		1	1.34	1.38	1.77	2.5	1.34	1.84	1.72
	8/10/2004		1	1.8	1.61	1.97		1.71	1.73	2.05
	10/6/2004		1	1.34	1.32	1.56	2.31	1.34	1.35	1.44
	3/8/2005		1	1.62	1.44	1.72	2.56	1.72	1.67	2.13
	5/24/2005		1	1.38	1.37	1.56	2.24	1.39	1.22	1.82
	8/16/2005		1	1.29	1.47	1.6	1.86	1.36	1.29	1.69
	10/11/2005		1	1.34	1.43	1.53	2.1	1.63	1.39	1.44
Phosphorus (Total) (P)										
	3/15/1995		1	0.136	0.225	0.253	0.2	0.306		
	5/15/1995		1	0.125	0.178	0.191	0.176	0.101		
	7/25/1995		1	0.298	0.232	0.269	0.148	0.215		
	10/3/1995		1	0.216	0.226	0.297	0.213	0.169		
	3/25/1996		1	0.19	0.151	0.172		0.269		
	5/20/1996		1	0.174	0.195	0.243	0.181	0.176		
	6/4/1996		1	0.198	0.194	0.262	0.168	0.215		
	6/17/1996		1		0.169					
	7/1/1996		1	0.27	0.217	0.298	0.216	0.239		
	8/5/1996		1	0.266	0.257	0.286	0.214	0.27		
	9/3/1996		1	0.247	0.262	0.34	0.232	0.281		
	9/30/1996		1	0.296	0.268	0.29	0.351	0.164		
	3/4/1997		1	0.303	0.244	0.32	0.276	0.158		

Analyte	Collection Date	Detect Limit	Depth	380221	380233	380234	380235	380236	384160	385029
	5/14/1997		1	0.286	0.281	0.257	0.284	0.228		
	7/8/1997		1	0.315	0.303	0.309		0.253		
	7/16/1997		1				0.223			
	8/4/1997		1	0.315	0.223	0.219	0.186	0.381	0.269	
	9/2/1997		1	0.354	0.332	0.277	0.255	0.314	0.262	
	10/6/1997		1	0.31	0.312	0.281		0.248	0.191	
	5/19/1998		1	0.926	0.948		0.266			
	7/6/1998		1	0.417	0.359	0.276	0.361	0.449	0.404	
	8/3/1998		1	0.824	0.717	0.265	0.326	0.77	0.851	
	9/8/1998		1	0.412	0.352	0.459		0.482	0.485	
	10/19/1998		1	0.409	0.368	0.292	0.325	0.39	0.278	
	2/23/1999		1	0.398	0.488	0.318	0.336	0.316	0.298	
	5/25/1999		1	0.442	0.475	0.278	0.537		0.492	0.261
	8/2/1999		1	0.355	0.296	0.289	0.283		0.315	0.374
	10/11/1999		1	0.234	0.212	0.186	0.259		0.178	0.189
	2/14/2000		1	0.186	0.182	0.151	0.34		0.162	0.195
	5/2/2000		1	0.219	0.2	0.209	0.42		0.221	0.242
	8/1/2000		1	0.239	0.277	0.226	0.31		0.298	0.54
	10/9/2000		1	0.278	0.241	0.226	0.365	0.255	0.242	0.29
	3/19/2001		1	0.214	0.176	0.22	0.344	0.205	0.236	0.397
	5/14/2001		1	0.261	0.21	0.233	0.231	0.253	0.238	0.282
	8/6/2001		1	0.318	0.323	0.267	0.705	0.36	0.346	0.45
	10/10/2001		1	0.318	0.311	0.248	0.335	0.336	0.328	0.07
	2/11/2002		1	0.248	0.236	0.2	0.304	0.236	0.231	0.024
	5/13/2002		1	0.247	0.245	0.234	0.324	0.276	0.261	0.114
	8/13/2002		1	0.3	0.309	0.254	0.298	0.307	0.273	0.308
	10/7/2002		1	0.254	0.27	0.248	0.284	0.264	0.27	0.094
	2/10/2003		1	0.224	0.235	0.272	0.397	0.243	0.248	0.318
	5/7/2003		1	0.212	0.248	0.247	0.343	0.253	0.251	0.238
	8/12/2003		1	0.307	0.311	0.27	0.203	0.333	0.358	0.364
	10/7/2003		1	0.273	0.281	0.23	0.223	0.19	0.207	0.25
	3/16/2004		1	0.234	0.206	0.221		0.212	0.209	0.312
	5/18/2004		1	0.236	0.236	0.235	0.182	0.217	0.228	0.267
	8/10/2004		1	0.296	0.309	0.291		0.309	0.288	0.324
	10/6/2004		1	0.275	0.292	0.255	0.293	0.268	0.281	0.187
	3/8/2005		1	0.265	0.28	0.273	0.323	0.269	0.254	0.2
	5/24/2005		1	0.21	0.217	0.211	0.279	0.192	0.203	0.187
	8/16/2005		1	0.335	0.333	0.257	0.272	0.313	0.31	0.273
	10/11/2005		1	0.246	0.257	0.223	0.249	0.313	0.288	0.181

Analyte
Sulfate as (SO4)

Collection Date	Detect Limit	Depth	380221	380233	380234	380235	380236	384160	385029
3/15/1995		1	288	1020	1590	4850	554		
5/15/1995		1	461	870	1580	3770	397		
7/25/1995		1	697	930	1780	4280	423		
10/3/1995		1	859	882	1700	4230	600		
3/25/1996		1	950	757	1140		562		
5/20/1996		1	458	643	1300	4120	465		
6/4/1996		1	469	708	1510	4420	484		
7/1/1996		1	525	725	1570	4120	474		
8/5/1996		1	547	648	1440	3970	452		
9/3/1996		1	692	773	1710	3760	448		
9/30/1996		1	565	643	1370	3480	443		
3/4/1997		1	777	686	1170	4460	626		
5/14/1997		1	348	780	1500	4200	504		
7/8/1997		1	569	642	1180		427		
7/16/1997		1				3640			
8/4/1997		1	574	662	1200	3580	467	386	
9/2/1997		1	540	632	1110	3510	440	382	
10/6/1997		1	581	655	1130		468	424	
5/19/1998		1	546	596	999	3270	477	440	
7/6/1998		1	545	599	993	2790	470	447	
8/3/1998		1	585	597	1090	2780	511	486	
9/8/1998		1	583	632	1150		524	495	
10/19/1998		1	622	652	1230	2950	529	516	
2/23/1999		1	663	674	1310	3080	622	595	
5/25/1999		1	490	607	1120	2760		449	155
8/2/1999		1	553	562	1110	2690		452	195
10/11/1999		1	589	605	1180	2780		485	219
2/14/2000		1	622	636	1220	2710		560	321
5/2/2000		1	614	644	1200	2740		539	338
8/1/2000		1	611	629	1140	2640		540	385
10/9/2000		1	617	627	1130	2530	561	554	404
3/19/2001		1	662	635	971	2210	627	632	283
5/14/2001		1	463	663	1150	2400	610	577	282
8/6/2001		1	600	627	1090	2390	582	554	350
10/10/2001		1	628	655	1150	2480	599	591	354
2/11/2002		1	671	683	1120	2480	687	682	415
5/13/2002		1	582	552	1040	1920	579	492	357
8/13/2002		1	635	663	1120	2330	634	632	473
10/7/2002		1	622	660	1060	2220	632	611	336
2/10/2003		1	728	744	1220	2220	735	745	620
5/7/2003		1	518	610	901	2110	611	572	422
8/12/2003		1	656	658	1010	2130	613	608	498

Analyte	Collection Date	Detect Limit	Depth	380221	380233	380234	380235	380236	384160	385029
	10/7/2003		1	695	679	1070	2260	657	636	555
	3/16/2004		1	730	764	967		740	783	680
	5/18/2004		1	562	654	984	1900	620	599	419
	8/10/2004		1	636	515	1010		607	628	431
	10/6/2004		1	639	673	1030	1910	633	625	453
	3/8/2005		1	663	683	980	1910	675	688	564
	5/24/2005		1	633	663	969	1710	612	611	460
	8/16/2005		1	595	650	979	1660	595	626	424
	10/11/2005		1	621	648	959	1580	618	625	451